FF
2100 x 2150

DECK
8'0" x 6'3"

1.0 TR ODU HT=350

UTILITY
5'0" x 3'0"

KITCHEN
8'0" x 10'0"

BEDROOM - 3
10'6" x 12"0"

BEDROOM - 2
10'6" x 12"6"

LIVING & DINING
11'0" x 20"0"

TOTAL 6 UNIT

LVDB

LPDB

PASSAGE
3'5" WIDE

M. BEDROOM - 1
10'6" x 12"0"

STUDY
5'0" x 7'6"

8'0" x 5'0"

5'0" x 8'0"

UP

DN

STAIR - 1

CUTOUT IN WALL

SEC-02

PRESSURISATION

STAIRCASE PRESSURIZATION SHAFT

PLUMBING DUCT

D1

D2

w1

w2


w3

F2

1:50


3 BHK Unit 3) & (Unit 1)
Typ Floor
10/8/2022


PDA.
3BHK (Unit 2)
4/8/2022

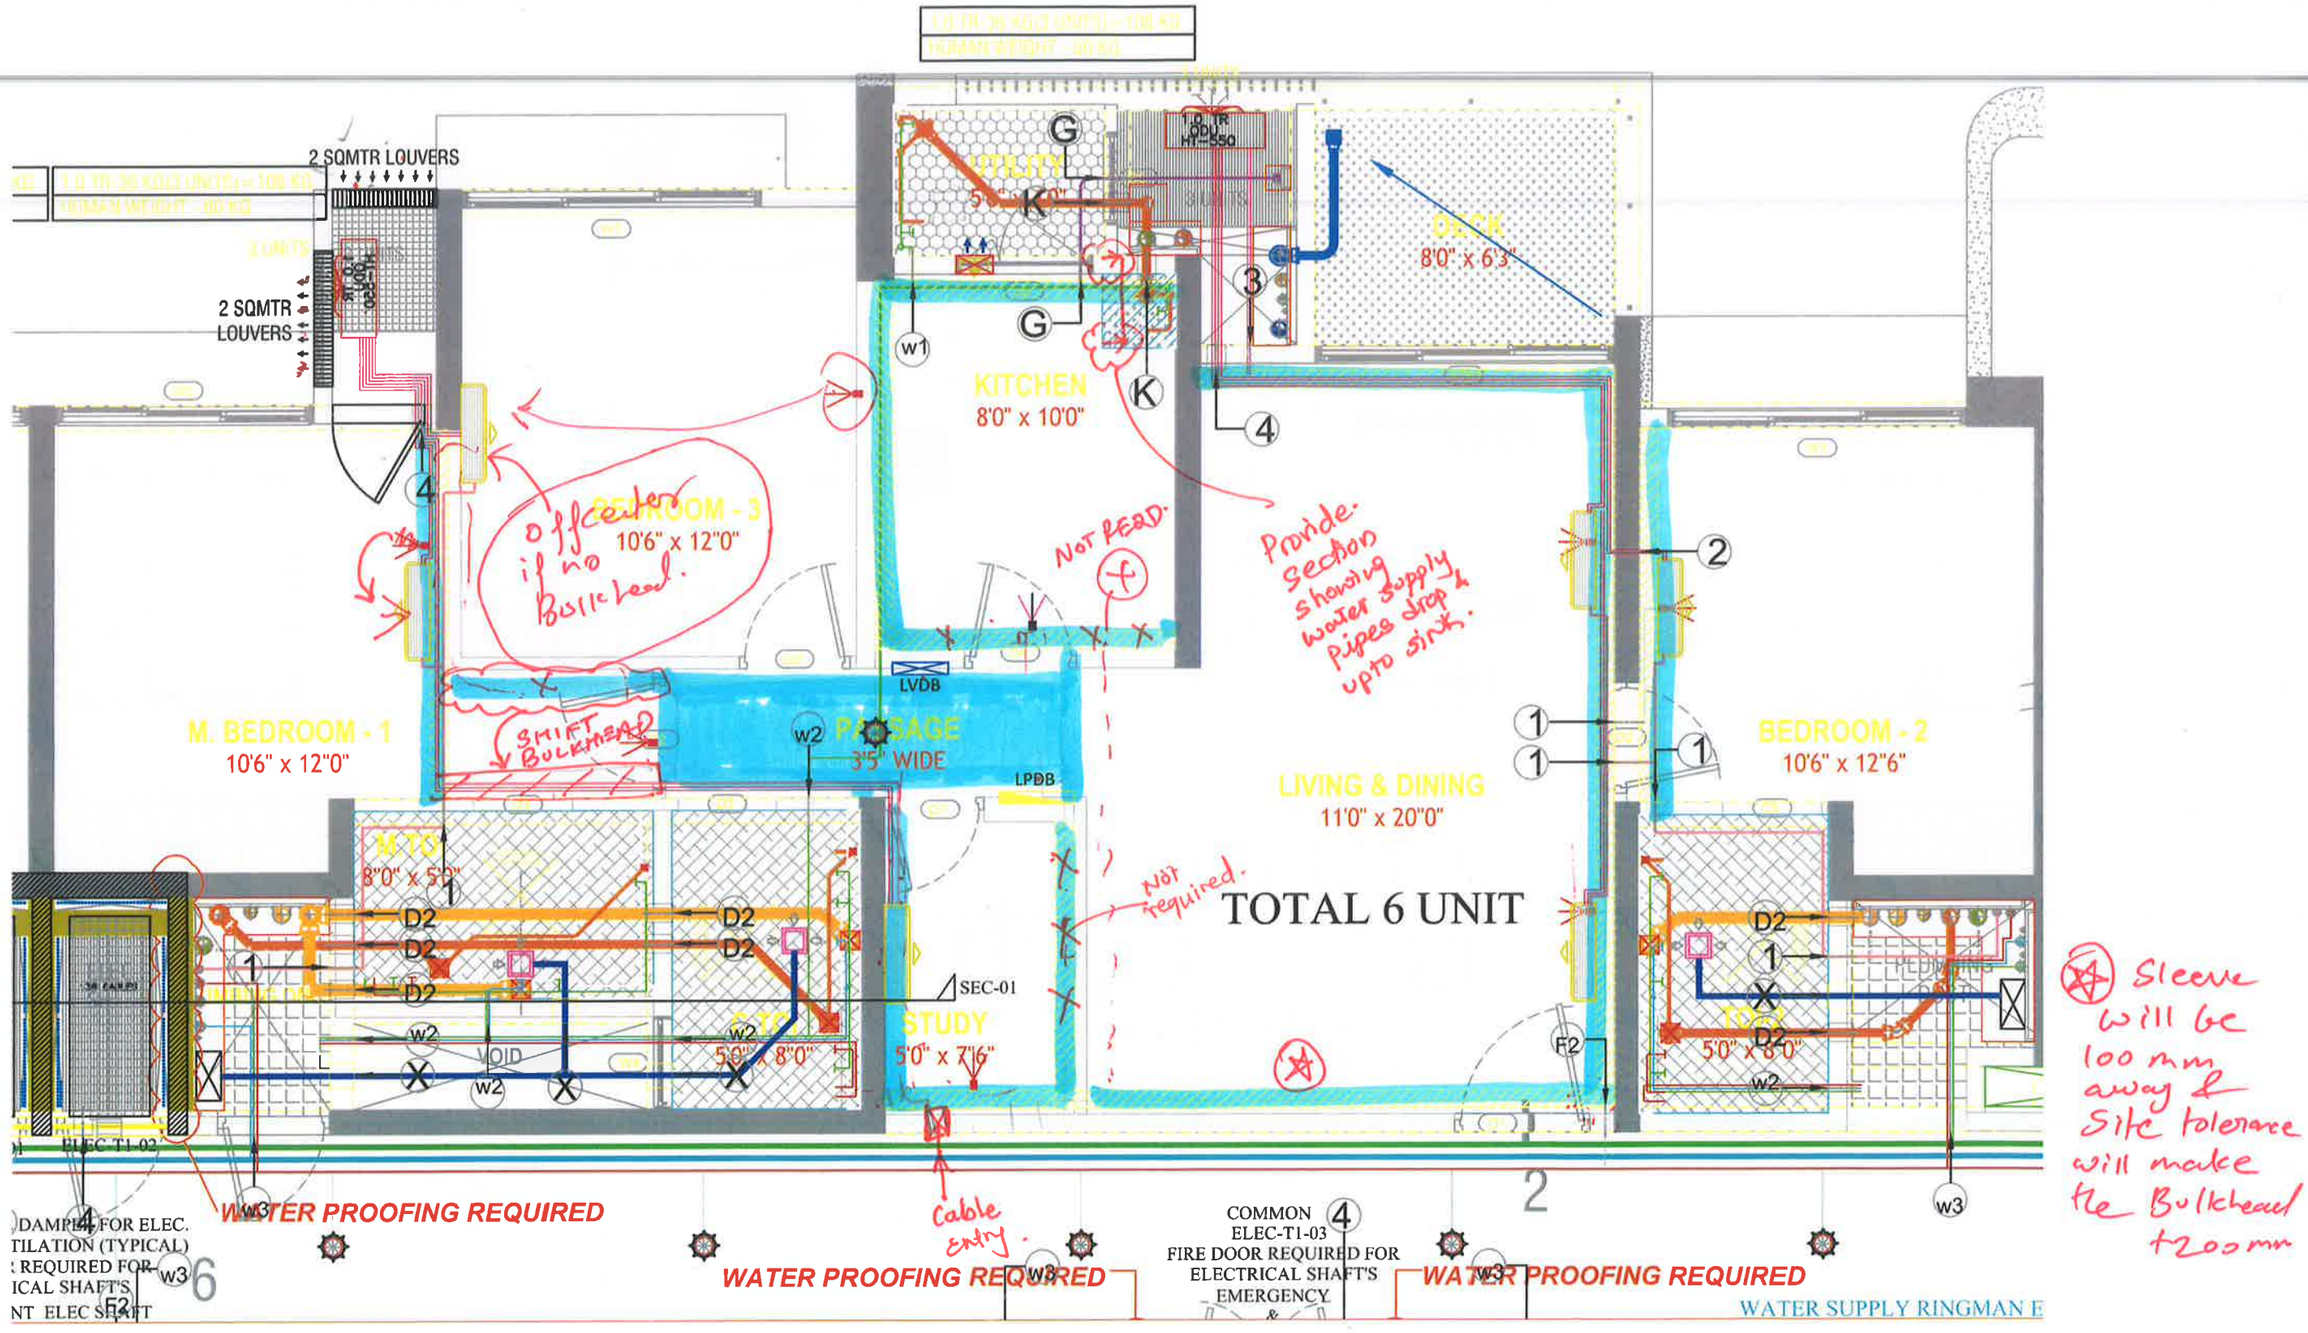

10/8/2022

1:50

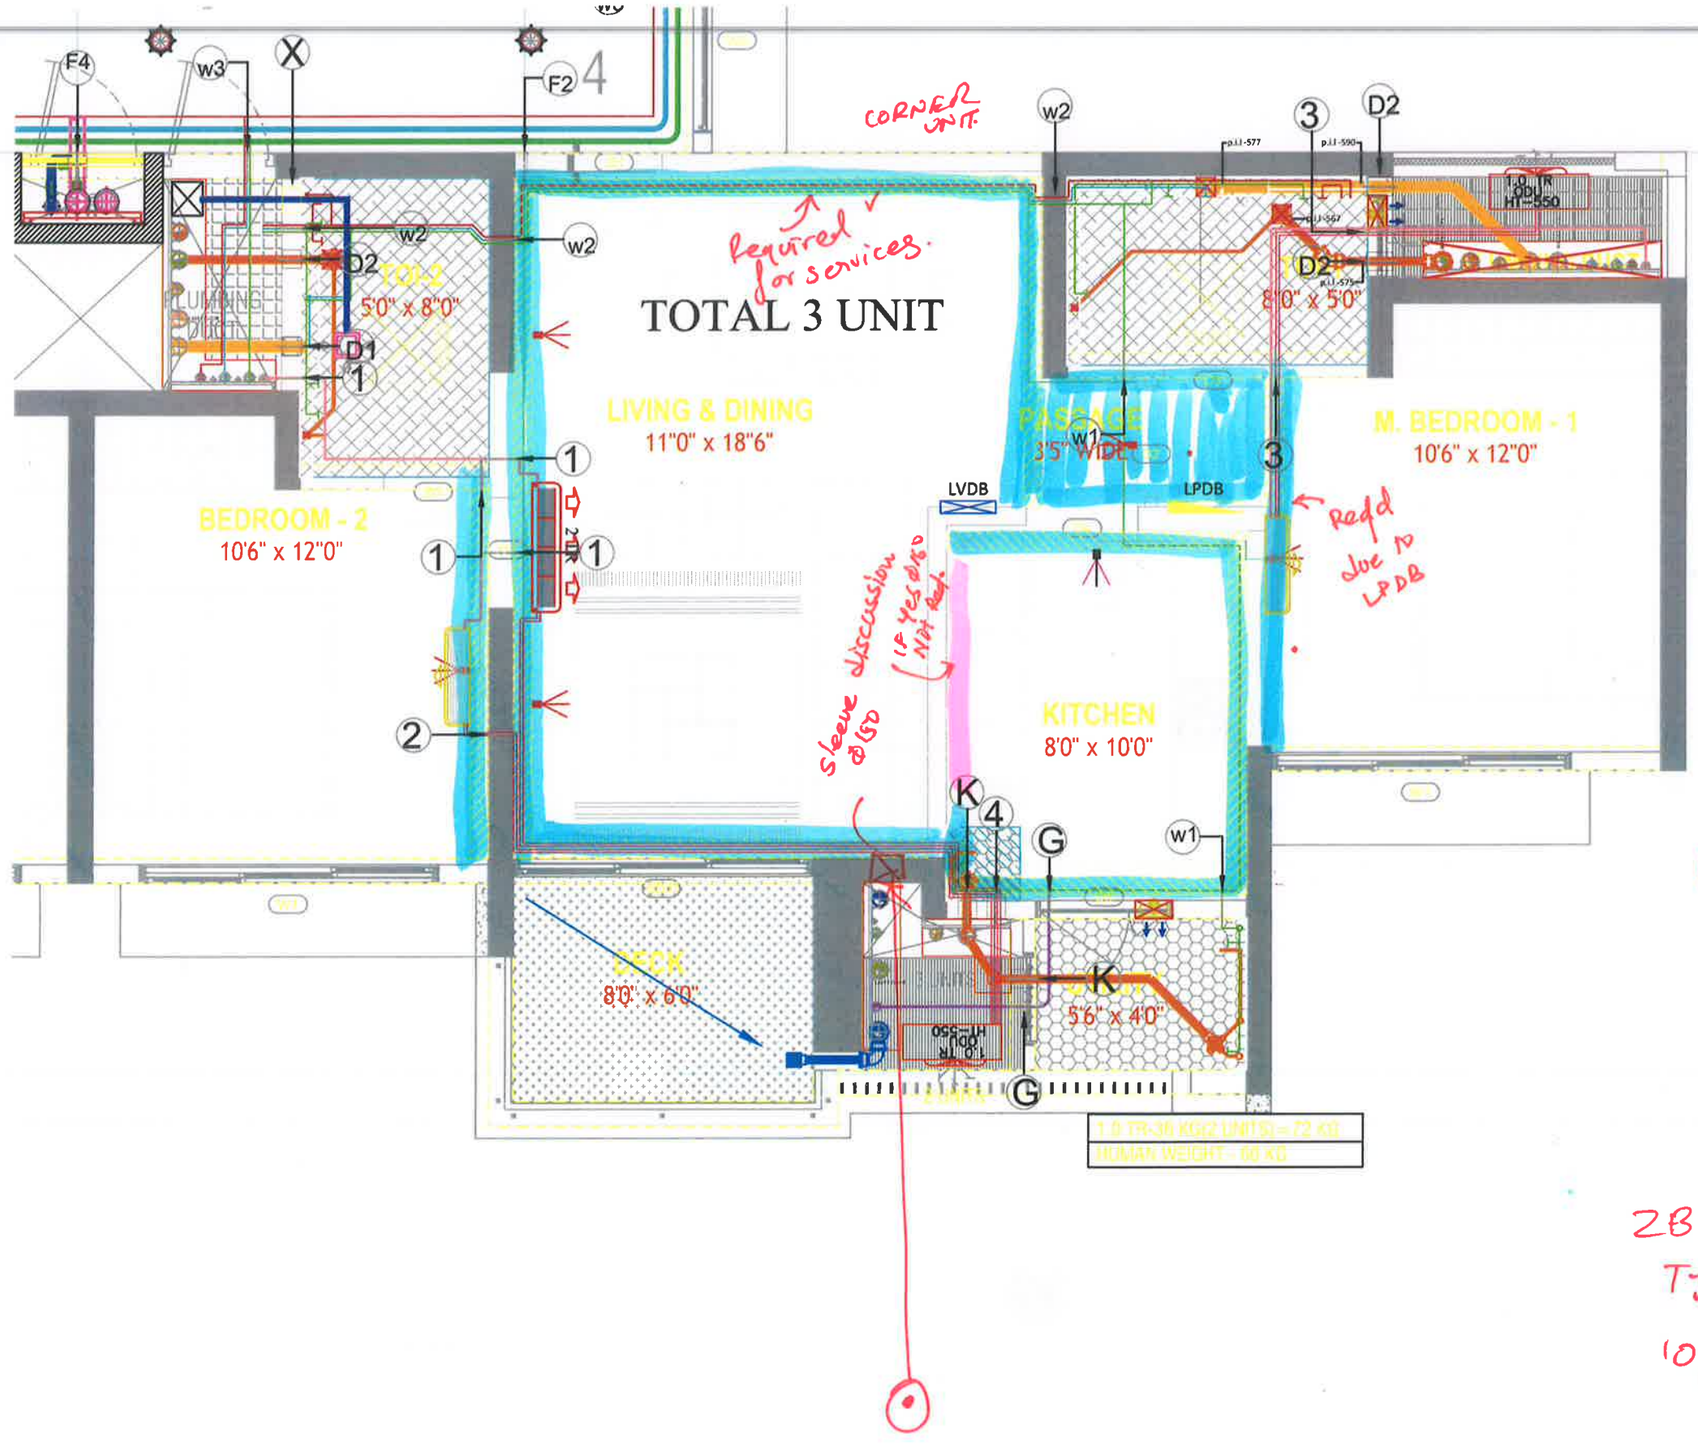
TOTAL 3 UNIT
CORNER UNIT
required for services.
LIVING & DINING
11'0" x 18'6"
BEDROOM - 2
10'6" x 12'0"
PASSAGE
3'5" WIDE
M. BEDROOM - 1
10'6" x 12'0"
KITCHEN
8'0" x 10'0"
DECK
8'0" x 6'0"
TOI-2
5'0" x 8'0"
TOI-1
5'6" x 4'0"
LVDB
LPDB
Reqd due to LPDB
Sleeve discussion
If yes dia 150 NA Req.
If 150ϕ Sleeve can be provided in the location indicated then the bulkhead can be avoided in kitchen (units 4, 5, 10 & 11)
2BHK (Unit 4)
Typ. Floor
10/8/2022
1:50

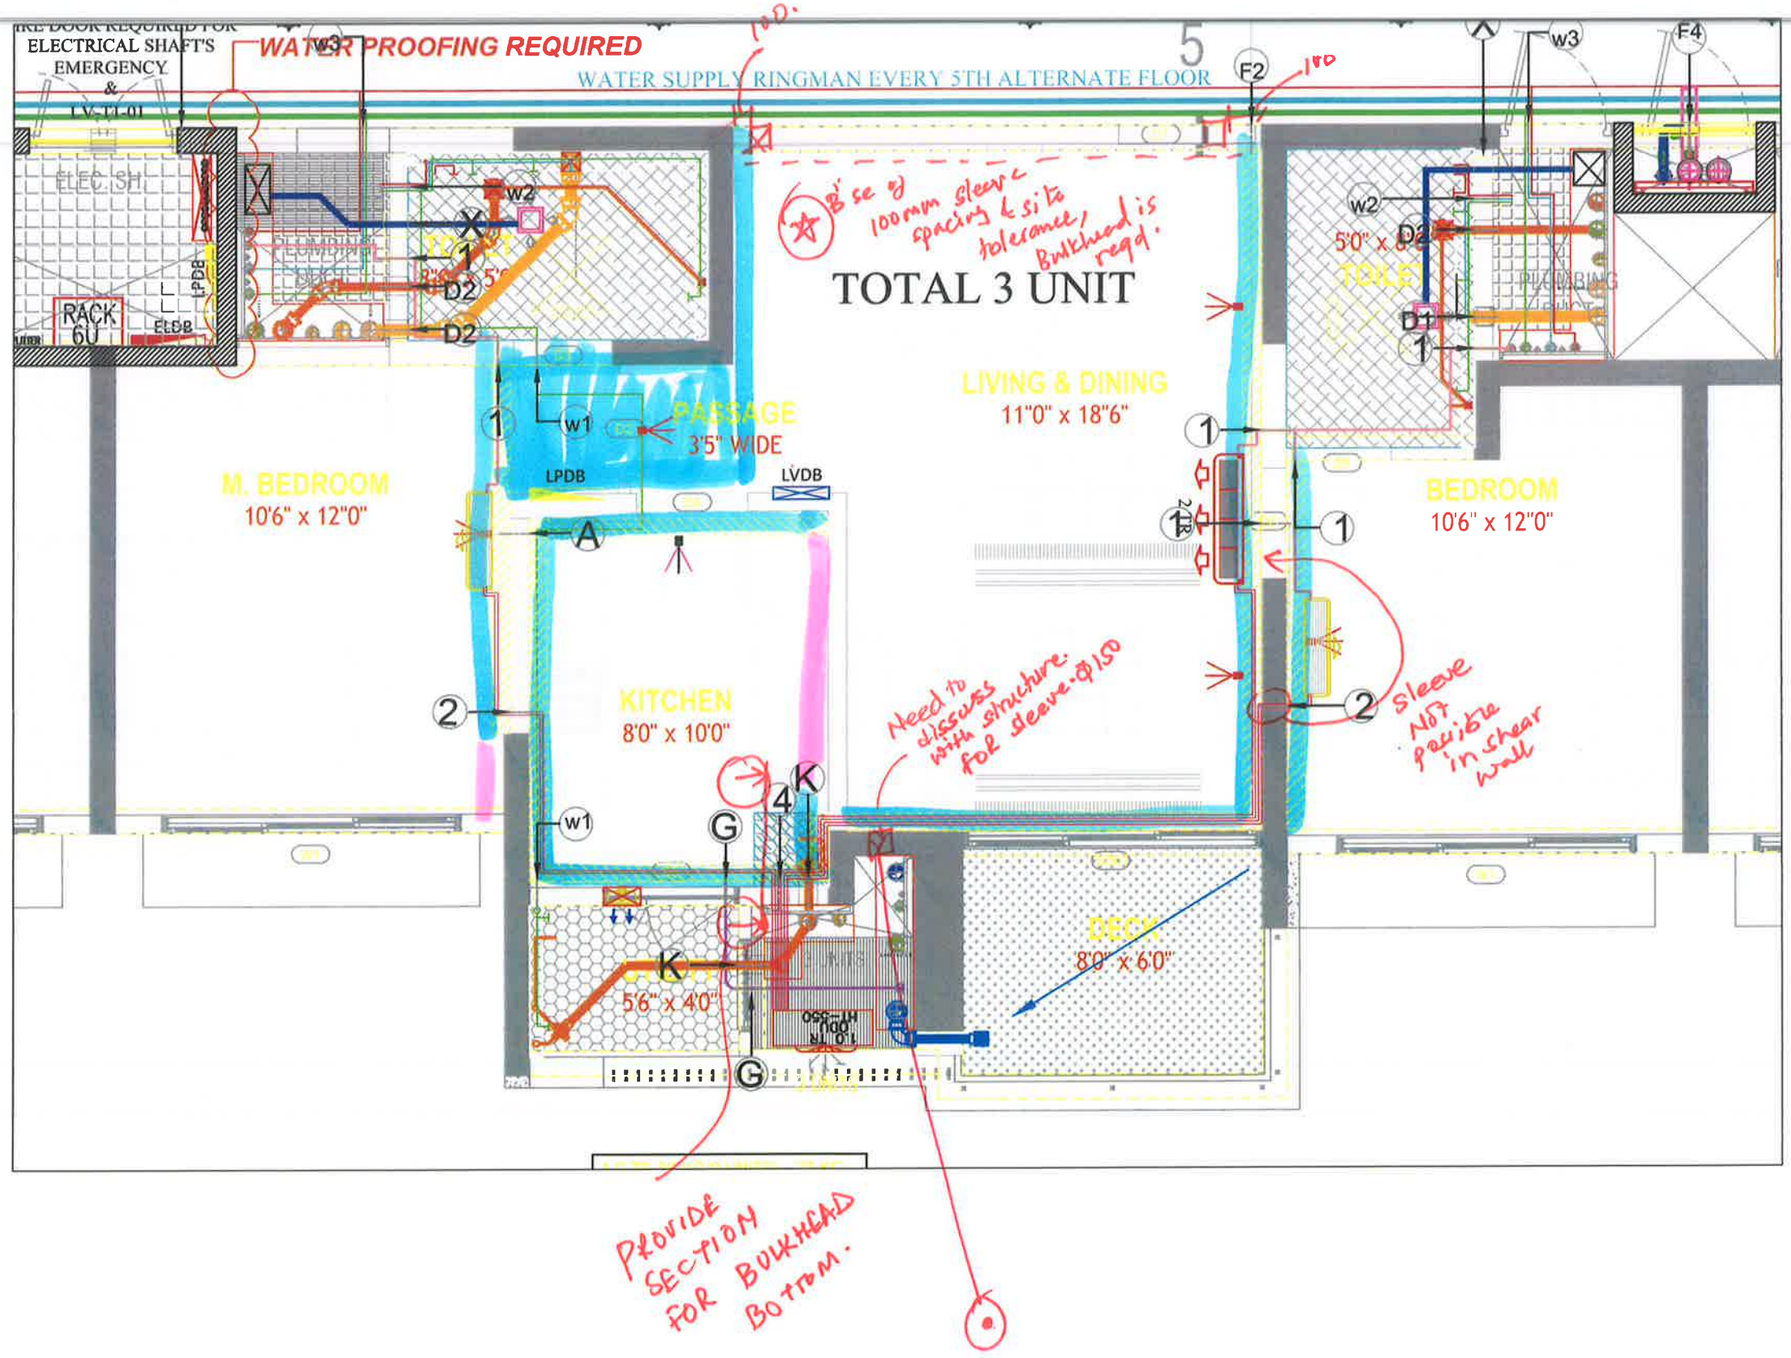

Base of 100mm sleeve spacing & site tolerance, Bulkhead is reqd.

If 150 ϕ sleeve can be provided in the location then one bulkhead can be avoided in kitchen. (units 4, 5, 10 & 11)

Sleeve will be 100 mm away & site tolerance will make the bulkhead +200 mm

2BHK (units 5)
Typ. Floor
10/8/2022

1:50

SHAFT VENTILATION (TYPICAL)
FIRE DOOR REQUIRED FOR
ELECTRICAL SHAFT'S
APARTMENT ELEC SHAFT

WATER PROOFING REQUIRED

ELEC-TT-03
FIRE DOOR REQUIRED FOR
ELECTRICAL SHAFT'S
EMERGENCY
&
LV-TT-01

TOTAL 3 UNIT

LIFT-4
50 x 2500

LIFT-5
2375 x 3100

LIFT-6
2150 x 2500

LIVING & DINING
11'0" x 18'6"

TOILET
8'0" x 5'0"

PASSAGE
3'5" WIDE

LVDB

LPDB

M. BEDROOM - 2
10'6" x 12'0"

ELEC.SH

RACK
6U

ELDB

M. BEDROOM - 1
10'6" x 12'0"

TOILET
5'0" x 8'0"

KITCHEN
8'0" x 10'0"

DECK
8'0" x 6'0"

5'6" x 4'0"

Pelmet Recpt. of sleeve at corner N/A possible


Cable

Sleeve will be 100 mm away ← Site tolerance will make bulkhead +200 mm

THIS CAN BE AVOIDED. SHIFTING ODU & DRAIN. TO UTILITY SHAFT. PLEASE CORRECT.

ZB14K (Unit 6)
Typ. Floor
10/8/2022

1:50

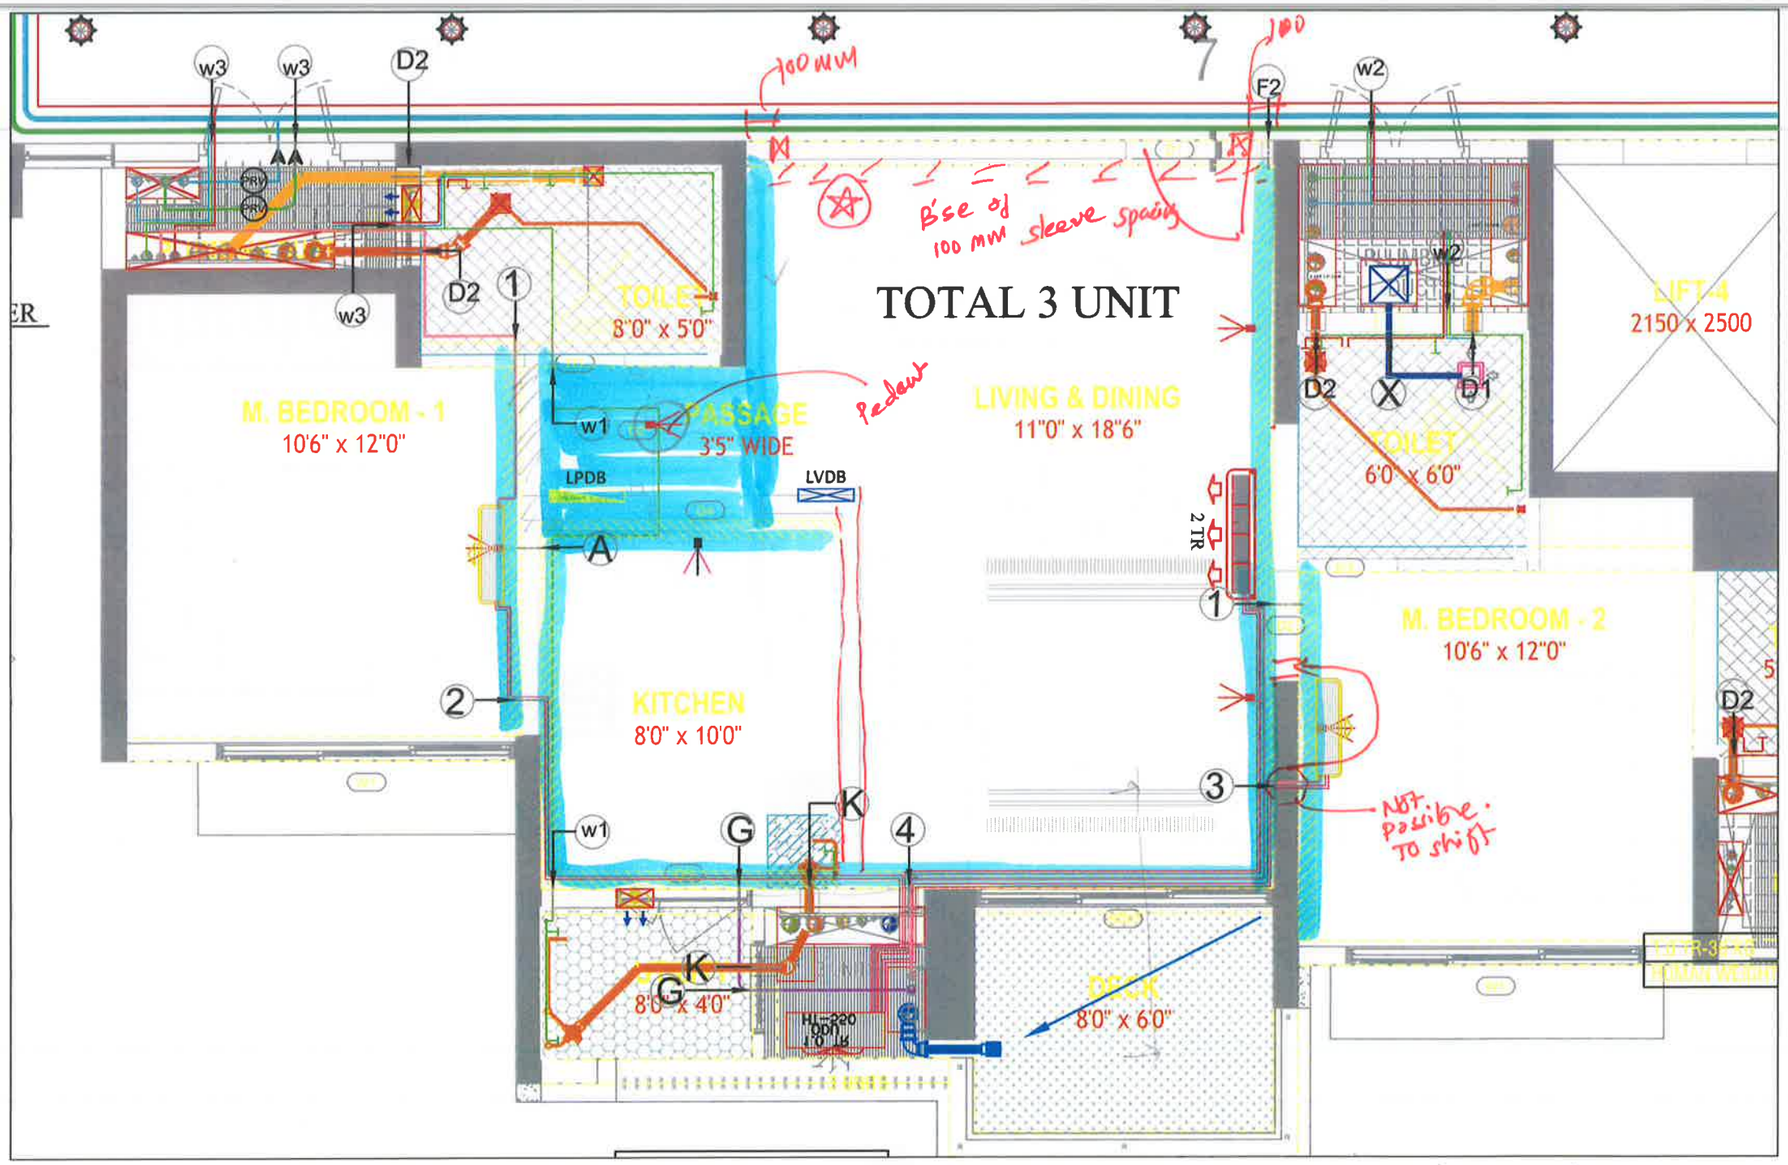


2BHK (Unit 7)
Typ. Floor
10/8/2022

1:50

(A) Sleeve will be 100 mm away & site tolerance will make for bulkhead +200mm

2BHK (UNIT B)

10/8/2022

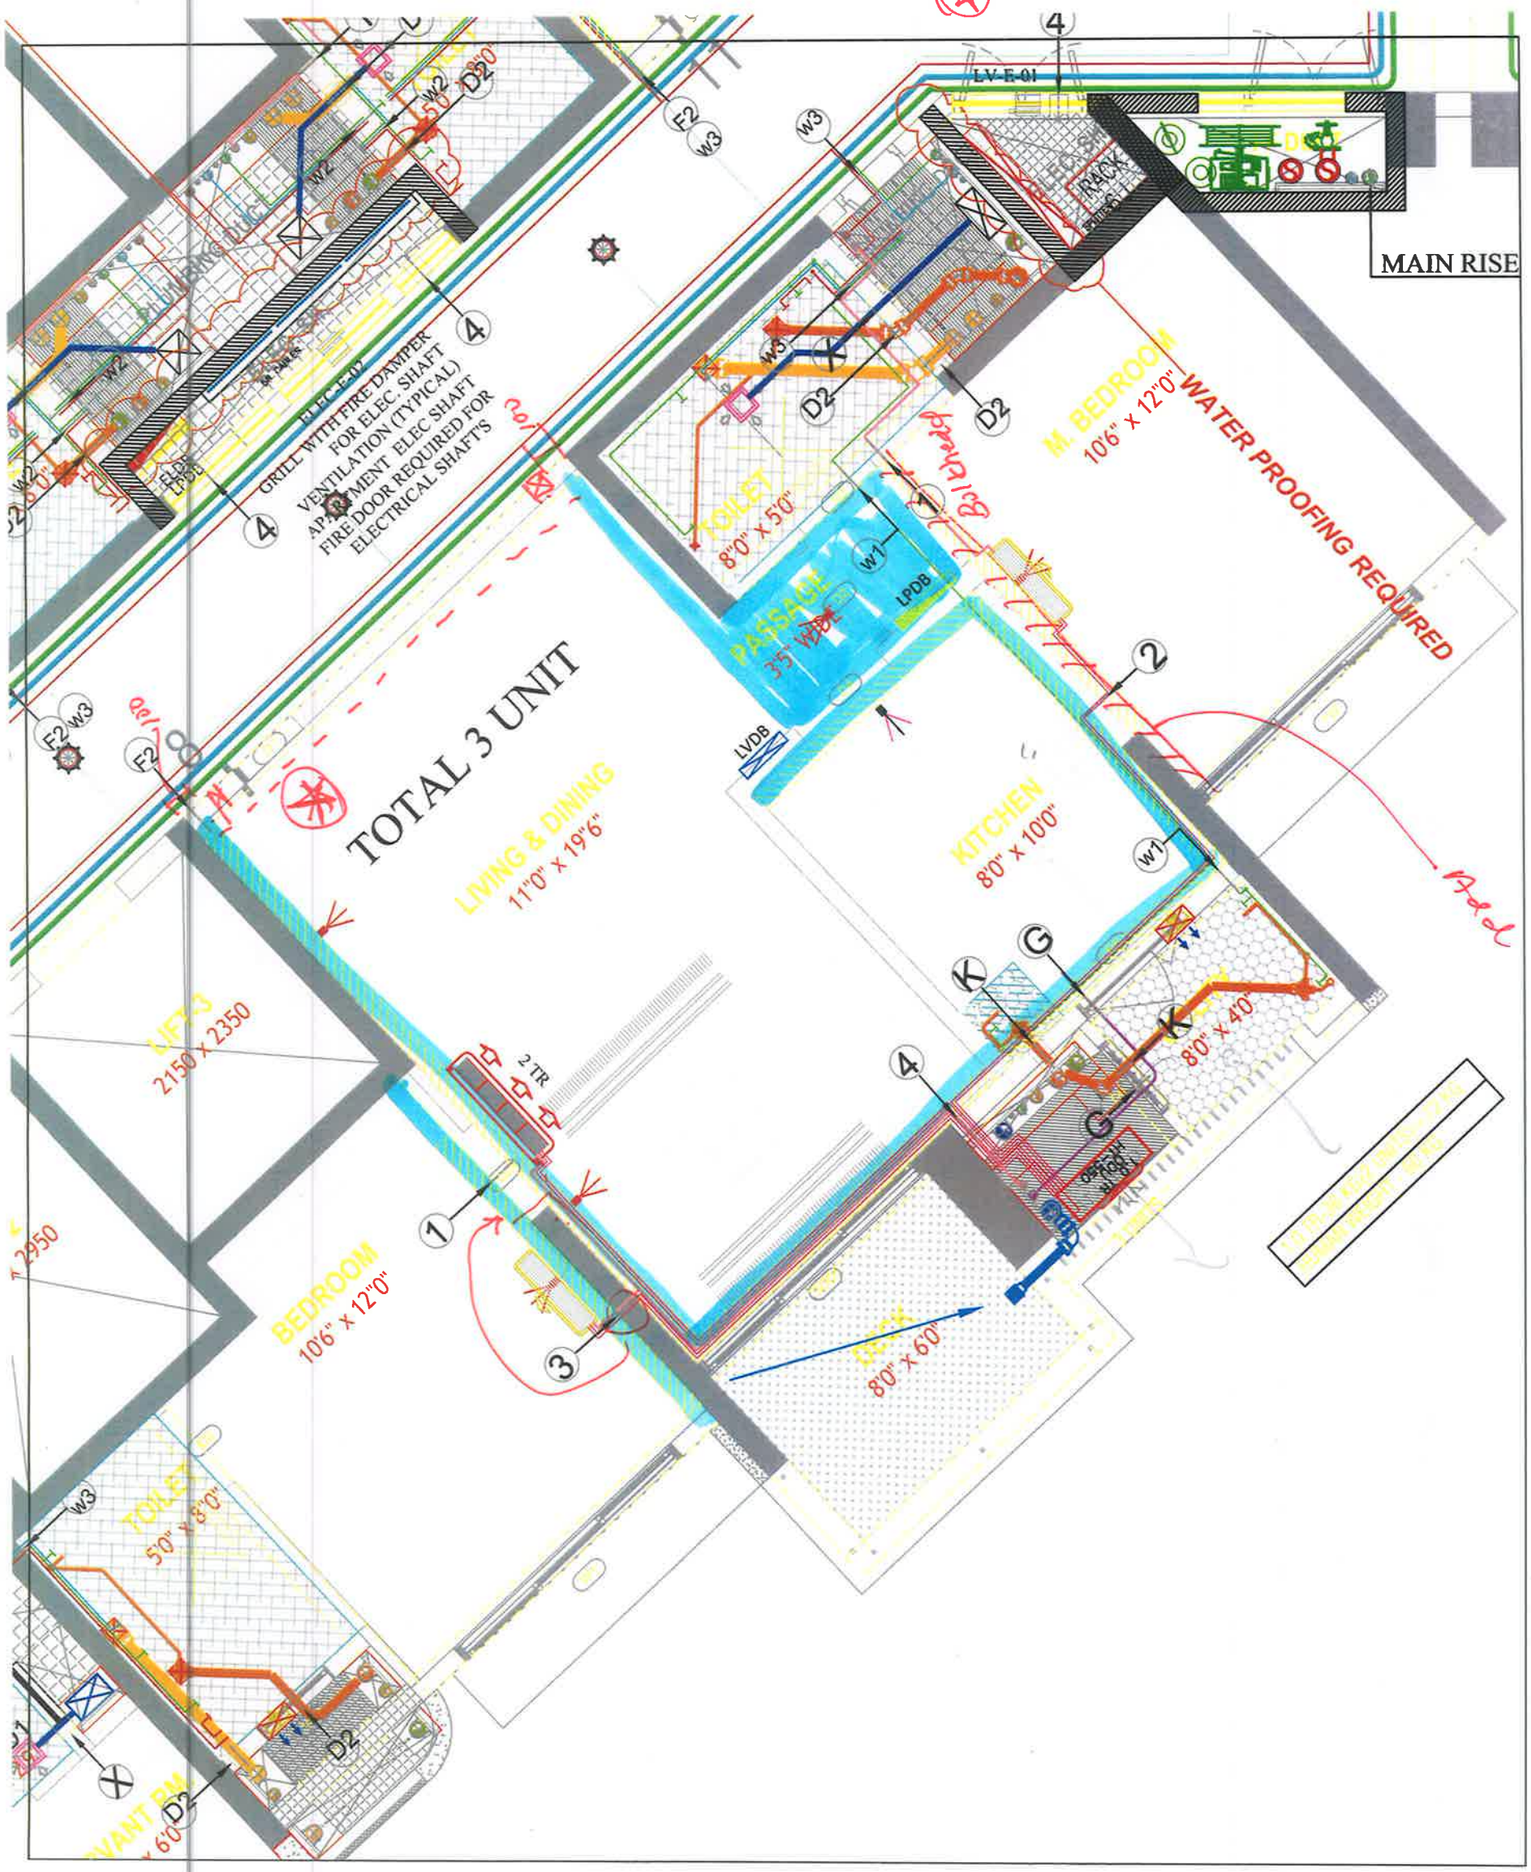

1:50