DONOT MENTION LEGEND IS ENOUGH

BL1 TO SHIFT AS THE DINING NICHE WILL BE UNDER DARK ZONE.

MAKE THE PELMET MATCH LIGHTER FOR VISIBILITY.

CHECK LOCATION.

FURNITURE LINES NOT VISIBLE.

(GENERAL PT) ARE THE DIM. UP TO CENTRE OF SB OR CORNER EDGE??

NUMBER THE SB FOR CHIMNEY HOB.


CAN K5 BE SHIFTED ON SHORTER WALL

AVOID SB ON SHEAR WALL. SHIFT SB EA UPWARDS

SHIFT WS LOCATION @ TV CENTER (BL2, TV & WS in a line above each other)


CENTERED ON DOOR

AVOID SHEAR WALL. SHIFT ON SHORTER WALL WITH SB @ 1250

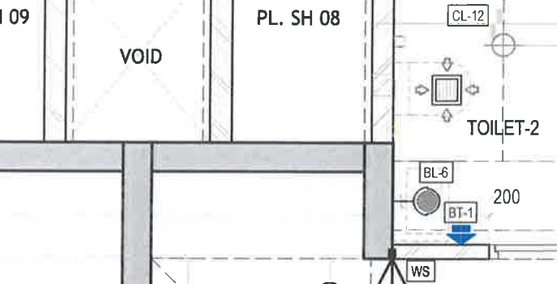

BEDROOM ELEVATION

TV, AC & SPRINKLER TO BE @ BED CENTER

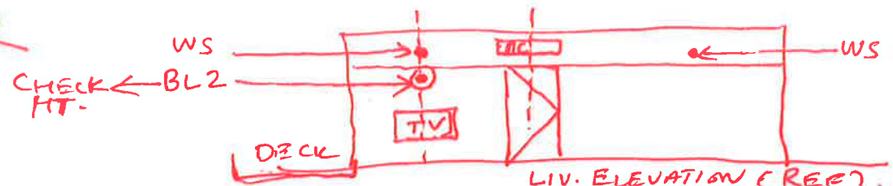

2BHK

2BHK

TOWER- E (2,3&4 UNITS)

SR.NO.	NO.	POINT CONTROL	MODULES	HT. OF SB (BTM OF SB FROM SL)	REMARKS
VP -E	1	VIDEO DOOR PHONE EXTERNAL	1	1250 MM	
VP -I	1	VIDEO DOOR PHONE INTERNAL	1	1250 MM	
		LIVING AND DINING			
LD-1	1	BL-1	1	1250 MM	
	2	FN-1 (ONLY REGULATOR)	1		
	3	CL-1	1		
	4	AC (SWITCH)	2		
LD-2	1	CL-2	1	1250 MM 650	
	2	CL-3	1		
	3	CL-5	1		
	4	FN-2 (ONLY REGULATOR)	1		
	5	6A-1 SOCKET WITH SWITCH	1	→ ADD ON LD2 (POLICY)	
LD-3	1	6-A - 1 SOCKETS WITH 1 SWITCH	1	650 MM	
	2	CL-4 (CHECK)	1		
LD-4	1	BL-2	1	600 MM	
	2	T.V + STB SWITCH	1		
	3	DATA	1		
	4	6-A - 1 SOCKETS WITH 1 SWITCH	3		
LD-5	1	20A-A.C BACK BOX WITH SOCKET	2	+250MM ABOVE BEAM BOTTOM[750 BEAM DEPTH]	
		KITCHEN AND UTILITY			
K-1	1	CL-12	1	1250MM	
	2	CL-13	1		
	3	FN-3 (ONLY REGULATOR)	2		
	4	EXHAUST FAN	1		
	5	16-A SWITCH FOR CHIMNEY HOB	2		
	5	6-A SOCKET & SWITCH (GENERAL)	3		
K-2	1	16-A SOCKET WITH SWITCH FOR REFRIDGERATOR	3	1250MM	
K-3	1	16-A SOCKET & SWITCH FOR MICROWAVE	3	375 MM FROM KITCHEN COUNTER TOP	
K-4	1	16-A SOCKET FOR CHIMNEY HOB	3	675MM FROM KITCHEN COUNTER TOP	
K-5	1	6-A SOCKET WITH SWITCH FOR WATER PURIFIER	3	675MM FROM KITCHEN COUNTER TOP	
U-1	1	CL-14			
	2	6-A SOCKET & SWITCH (GENERAL)	3	375 MM FROM KITCHEN COUNTER TOP	
U-2	1	16-A SOCKET WITH SWITCH FOR WASHING MACHINE	3	1250MM	
		MASTER BEDROOM-01			
MB-1	1	CL-6	1	1250MM	
MB-2	1	CL-7	1	650MM	
	2	FN-4 (ONLY REGULATOR)	2		
	3	AC (SWITCH) SHIFT TO MB3	2		
	4	6-A SOCKET & SWITCH (GENERAL)	3		
MB-3	1	CL-8	1	650MM	
	2	BL-4	1		
	3	6-A SOCKET & SWITCH (GENERAL)	3		
MB-4	1	T.V + STB SWITCH	1	650MM	
	2	6-A - 1 SOCKETS WITH 1 SWITCH	3		
MB-4A	1	6-A TV SOCKET	2	1050MM	
	2	6-A STB SOCKET	2		
	3	CABLE SOCKET	1		
MB-5	1	20A-A.C BACK BOX WITH SOCKET	2	+250MM ABOVE BEAM BOTTOM[750 BEAM DEPTH]	
		MASTER BEDROOM TOILET			
MT-1	1	BL-7	1	1250MM	
	2	CL-9	1		
	3	GEYSER (SWITCH WITH INDICATOR)	1		
	4	EXHAUST FAN	1		
	5	6-A SOCKET WITH SWITCH	3		
MT-2	1	20-A SOCKET FOR GEYSER	2	2150MM	
		BEDROOM-02			
B-1	1	CL-10	1	1250MM	
	2	CL-11 — SHIFT TO B3	1		
B-2	1	BL-5	1	650MM	
	2	FN-5 (ONLY REGULATOR)	2		
	3	6-A SOCKET WITH SWITCH	3		
B-3	1	AC (SWITCH)	2	650MM	
	2	6-A SOCKET WITH SWITCH	3		
B-4	1	20A-A.C BACK BOX WITH SOCKET	2	+250MM ABOVE BEAM BOTTOM[750 BEAM DEPTH]	
B-5	1	T.V + STB SWITCH	1	650MM	
	2	6-A - 1 SOCKETS WITH 1 SWITCH	3		
B-5A	1	6-A TV SOCKET	2	1050MM	
	2	6-A STB SOCKET	2		
	3	CABLE SOCKET	1		
		BEDROOM-02 TOILET			
BT-1	1	BL-6	1	1250MM	
	2	CL-12	1		
	3	GEYSER (SWITCH WITH INDICATOR)	1		
	4	EXHAUST FAN	1		
	5	6-A SOCKET WITH SWITCH	3		
BT-2	1	20-A SOCKET FOR GEYSER	2	2150MM	

CHECK COMMENT IN PLAN.

SHOULD BE ON SOFA SIDETABLE. LD3 (POLICY)

SEE COMMENT IN PLAN.

ADD LD4A FOR SOCKETS OF LD4.

THIS WILL NOT BE AS PER REFERENCE FILE. THE SPRINKLER WILL BE BELOW A C LVL GENERALLY.

PROVIDE SEPARATELY.

SEE COMMENTS.

CHECK COMMENT IN PLAN.

REMOVE THIS POINT & COMBINE WITH LD2

CHECK COMMENT ON PLAN.

WATER WILL SPLASH ON THE S.B.

CLG + EXHAUST TO BE COMBINED. (POLICY)

ABOVE FALSE CEILING.

CL12 + EXHAUST TO BE COMBINED. (POLICY)

TOILETS

OCCUPANCY SENSOR PROVISION TO BE CHECKED WITH MEP