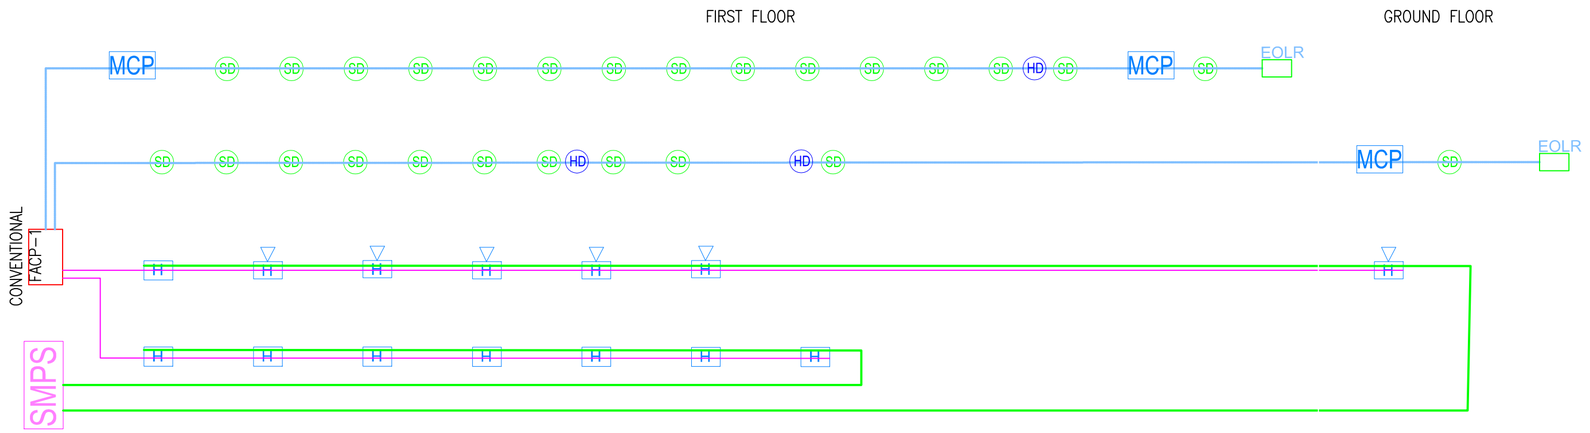


HARESH

Digitally signed by HARESH
DN: C=IN, OU=LODHA DESIGN, O=LODHA DEVELOPERS, CN=HARESH, E=haresh.bhanushali@lodhagroup.com
Reason: I am the author of this document
Location: your signing location here
Date: 2022.02.24 15:14:56+05'30'
Foxit PDF Reader Version: 11.2.1

Rohit Giridhar Uchil

Digitally signed by Rohit Giridhar Uchil
Date: 2022.02.16 13:46:02 +05'30'

FIRE ALARM LEGENDS LIST	
SYMBOL	DISCRIPTION
SD	SMOKE DETECTOR - 26 NOS
HD	HEAT DETECTOR QTY - 3 NOS
GD	GAS DETECTOR - 1NO
FACP-1	CONVENTIONAL FACP PANEL-1NO-WITH BATTERY
	FIRE ALARM LOOP CABLE - 306 MTR 2 C X 1.5 SQ. MM ARMOURED FRLS COPPER CABLES
SMPS	FMPS- 1NO
	HOOTER CABLE - 200 MTR 2 C X 1.0 SQ. MM ARMOURED FRLS COPPER CABLES
H	WALL MOUNTED HOOTER CUM SOUNDER- 6 NOS
H	CEILING/COVE MOUNTED HOOTER CUM SOUNDER - 7 NOS
EOLR	EOLR- 2NOS
WIFI	WIFI- NOS
MCP	MANUAL CALL POINT- 3NOS


SERVICES CONSULTANT : -

integrated TECHNICAL SERVICES

1703, 17th FLOOR, RUPAREL IRIS,
SENAPATI BAPAT MARG,
NEAR BIG BAZAR, MATUNGA ROAD (WEST),
MUMBAI - 400 016.
CONTACT : +9122 24388333/24210050
EMAIL ID - mumbai@itsce.co.in
W : www.its-mep.in

Jangbahadur Sonkar

Digitally signed by Jangbahadur Sonkar
DN: C=IN, OU=Lodha Group, O=Lodha Group, CN=Jangbahadur Sonkar, E=jangbahadur.sonkar@lodhagroup.com
Reason: I am approving this document
Location: your signing location here
Date: 2022.02.17 17:39:04+05'30'
Foxit PDF Reader Version: 11.1.0



REV.	DATE	DESCRIPTION	DRAWN BY
R0	02.02.2022	VALID FOR CONSTRUCTION	DIGAMBAR

PROJECT : -
LODHA ACME OZONE (SG & SF), THANE

CLIENT : -
M/S. LODHA GROUP

ARCHITECT : -
M/S. LODHA GROUP IN-HOUSE.

TITLE : -
FIRE ALARM & PA SYSTEM SLD LAYOUT FOR GROUND & FIRST FLOOR

DATE	14/06/2021
SCALE	NTS
PAPER SIZE	A-2
DRAWN BY	DIGAMBAR
CHECKED BY	BABITA
APPROVED BY	ROHIT

DRAWING NO.	REV. NO.
ITS-689- PA / FA -02	R-0

©THIS DRAWING AND DESIGN REMAINS THE PROPERTY OF INTEGRATED TECHNICAL SERVICES AND MAY NOT BE COPIED WITHOUT PRIOR WRITTEN APPROVAL FROM THE COMPANY.