

9/6/19 (1)
LAKEFRONT
TYPICAL FLOOR DOOR DETAILS.

FOR TYPICAL FLOOR IT SHOULD BE D1.

D1A
SINGLE LEAF WOODEN FLUSH DOOR

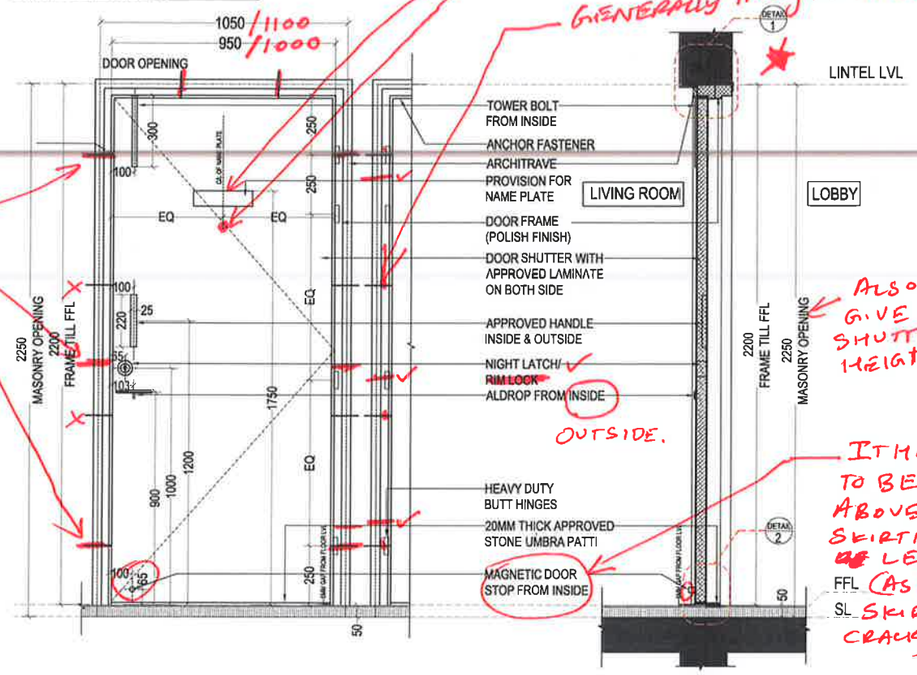


NAME PLATE TO BE AS PER ATTACHED FILE
EYE VIEWER REQUIRED.
GENERALLY THEY GO STAGGERED.
ANCHOR FASTENERS TO BE 3 NOS. ON EACH SIDE & 2 ABOVE
ALSO GIVE SHUTTER HEIGHT.
OUTSIDE.
IT HAS TO BE ABOVE THE SKIRTING LEVEL (AS THE SKIRTING CRACKS)

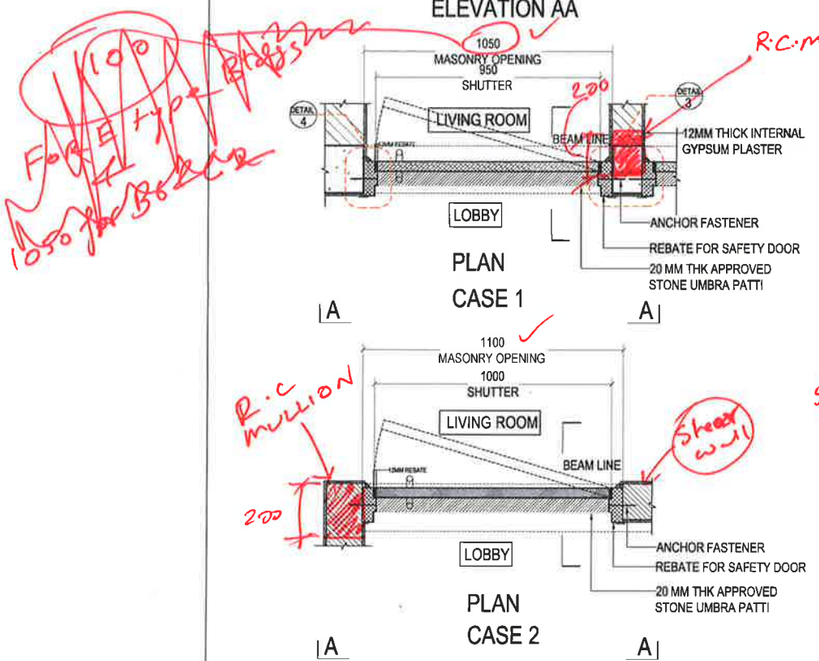



R.C. MULLION
1. CHANGE THE DETAIL AS PROPOSED (RECESSED)
2. DOES IT APPLY FOR 2.5 BHK DOOR ALSO ??
3. THE PLAN CONDITION TO MATCH WITH ACTUAL AS PER CIVIL DWG ISSUED.
4. 10 mm FOAM MISSING BETWEEN WALL & FRAME 3 SIDES.

D2A
SINGLE LEAF WOODEN FLUSH DOOR

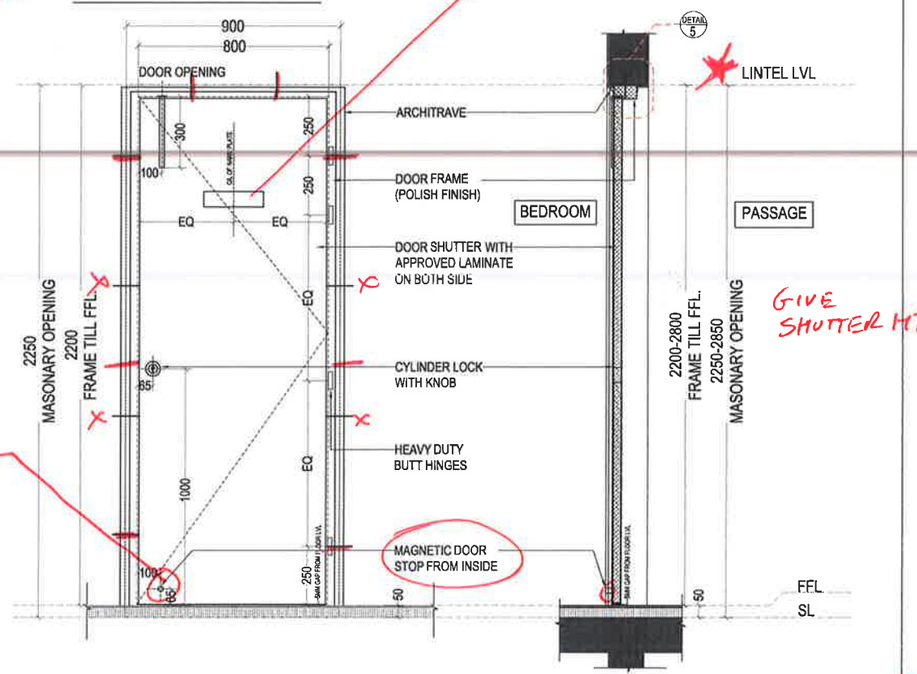

NAME PLATE REMOVE.
GIVE SHUTTER HT.

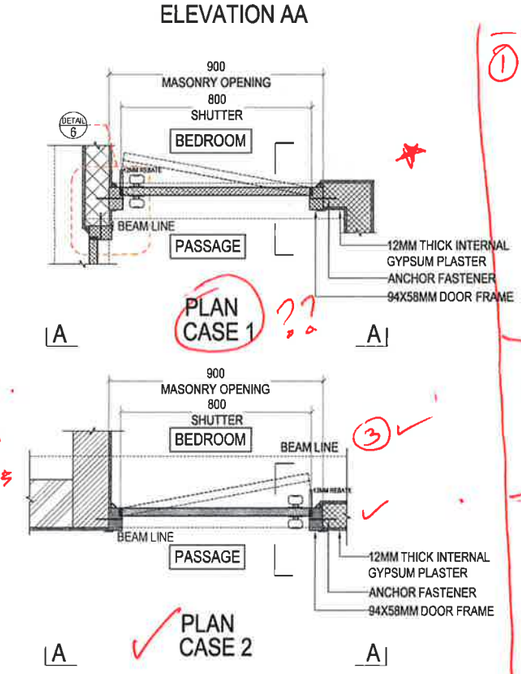

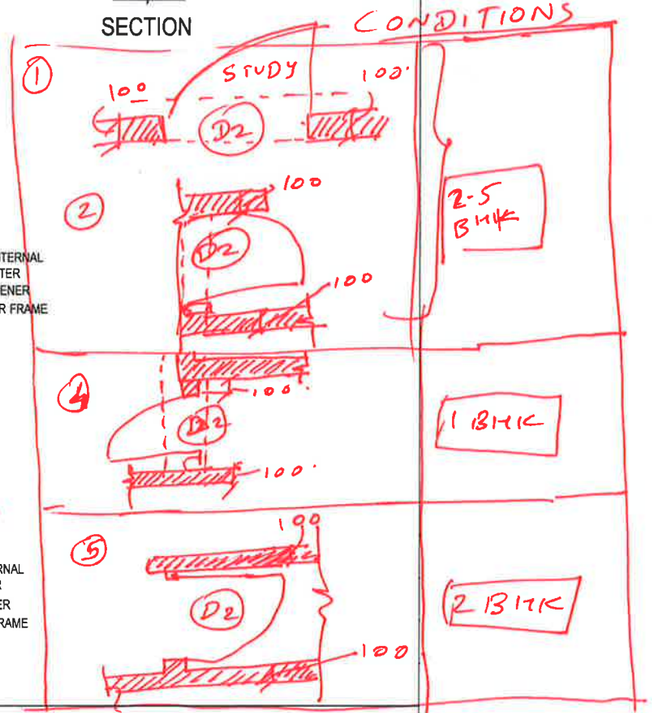


TYPE	D1A (SINGLE LEAF WOODEN FLUSH DOOR) TYPICAL FLOOR	TYPE	D2A (SINGLE LEAF WOODEN FLUSH DOOR)
STRUCTURAL SIZE OPENING	1050 X 2250 ~~X~~ 1100 X 2250	STRUCTURAL SIZE OPENING	900 X 2250
LOCATION	MAIN ENTRY	LOCATION	BEDROOM
FRAME TYPE	RED MIRANTI FRAME OF SIZE 144 X 58 FINISHED ~~IN MELAMINE POLISH~~ IN 3 COATS OF POLISH.	FRAME TYPE	RED MIRANTI FRAME OF SIZE 94 X 58 FINISHED ~~IN MELAMINE POLISH~~ 3 COATS OF POLISH.
SHUTTER TYPE	~~40-45~~ 38MM THICK SOLID CORE FLUSH DOOR, FINISHED WITH 1MM THK LAMINATE ON BOTH SIDES	SHUTTER TYPE ✓	32MM THICK SOLID CORE FLUSH DOOR, FINISHED WITH 1MM THK LAMINATE ON BOTH SIDES

9/6/19 (2)
TYPICAL UTILITY DOOR

B4

D4A


ALUMINUM & GLASS PANEL DOOR

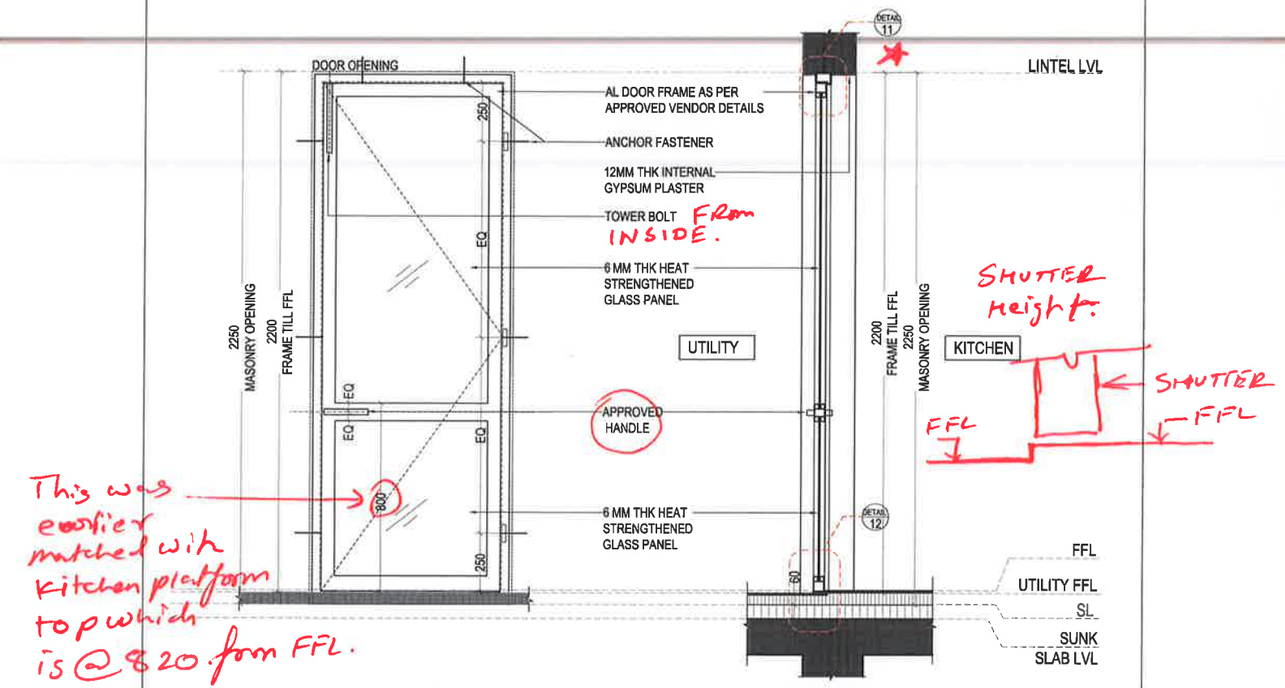

This was earlier matched with kitchen platform top which is @ 820 from FFL.

ELEVATION AA

SECTION

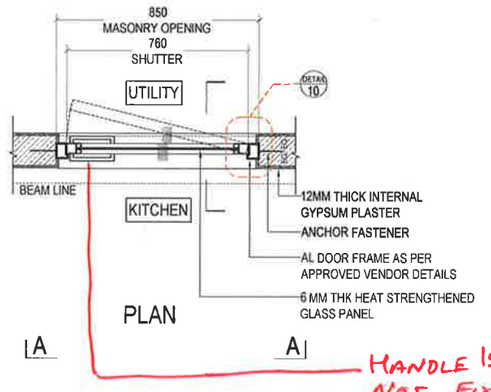

PLAN

* 10 mm Foam is missing

HANDLE IS LEVER TYPE. NOT FIXED.

TYPE	D4A (ALUMINUM & GLASS PANEL DOOR) TYPICAL FLOOR
STRUCTURAL SIZE OPENING	850 X 2250
LOCATION	KITCHEN UTILITY
FRAME TYPE	ALUMINIUM DOOR FRAME, AS PER VENDOR
SHUTTER TYPE	ALUMINIUM SHUTTER WITH HEAT STRENGTHENED GLASS & POWDER COATED.


9/6/19 (3)

1

FD1A → HTS. WILL BE DIFF. FOR ST.1 & ST2 IN A SAME WING BASED ON NO. OF INITIAL RISERS IN 'E' TYPE.


D6A

SINGLE LEAF METAL DOOR

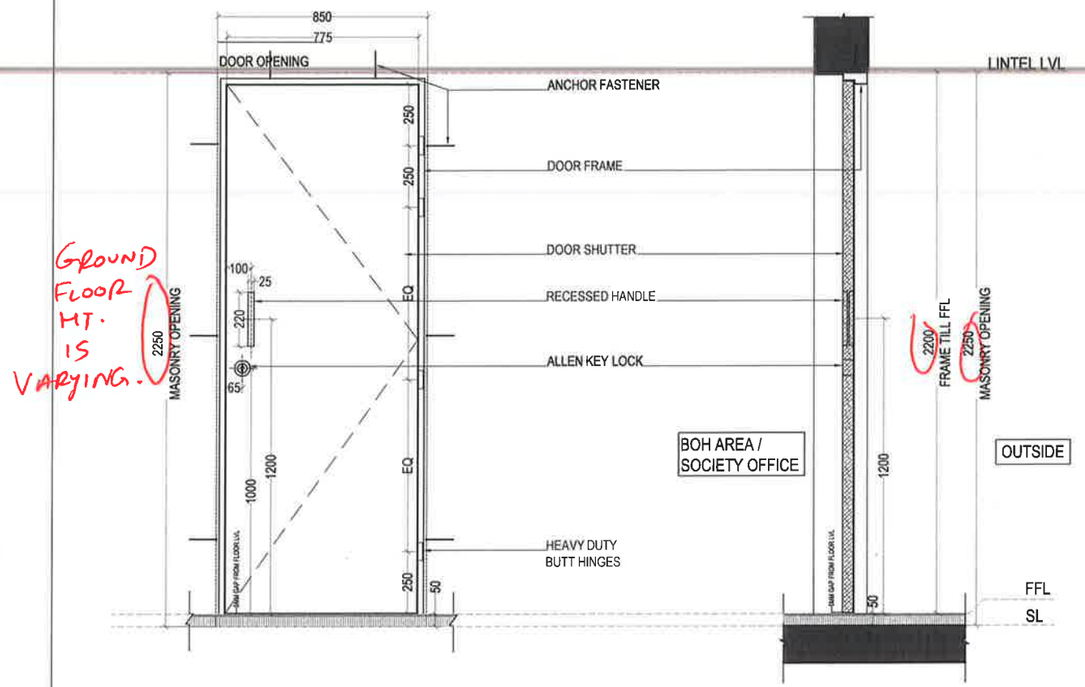


GROUND FLOOR HT. IS VARYING.


CONDITIONS.

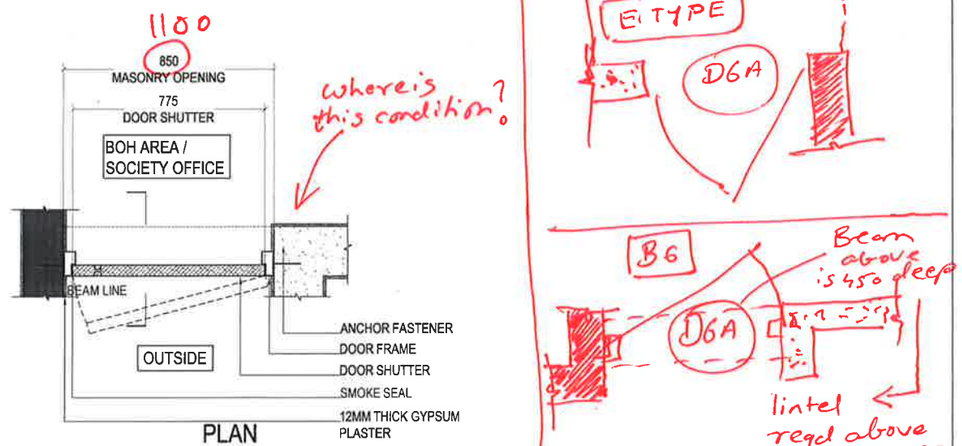

FD1A D5A — ?

SINGLE LEAF FIRE RATED DOOR

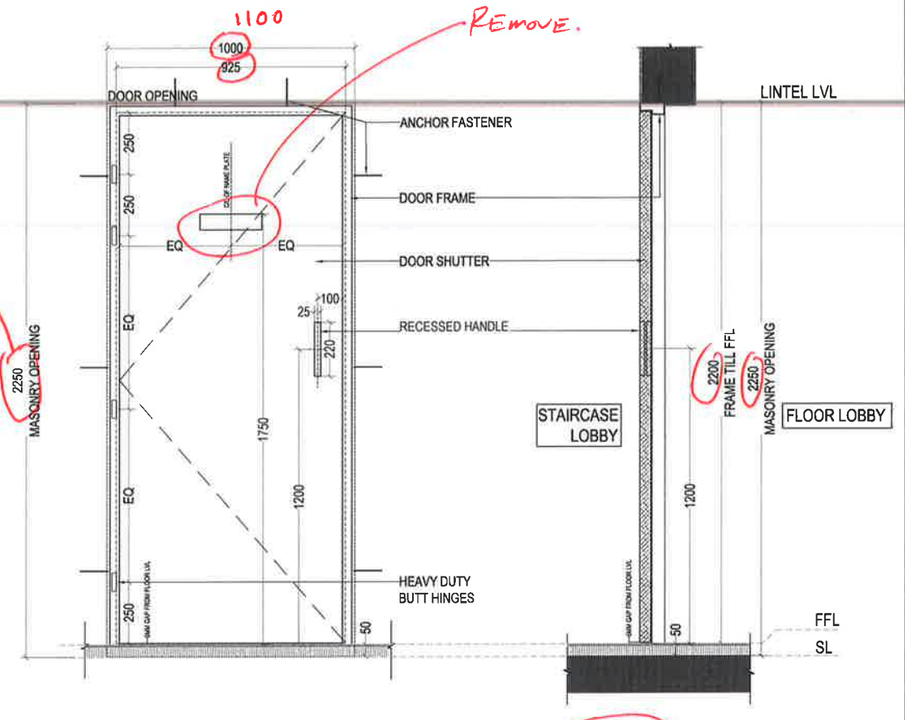

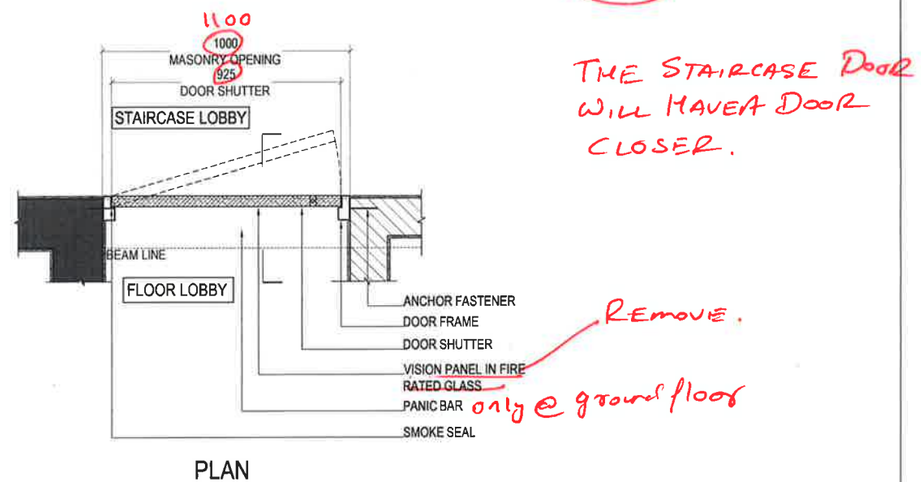

THE STAIRCASE DOOR WILL HAVE A DOOR CLOSER.

REMOVE.

only @ ground floor

TYPE	D6A (SINGLE LEAF METAL DOOR) GROUND FLOOR	TYPE	FD1A (SINGLE LEAF FIRE RATED DOOR) GROUND FLOOR
STRUCTURAL SIZE OPENING	850 X 2250 1100	STRUCTURAL SIZE OPENING	1100 X 2250
LOCATION	BOH AREA, SOCIETY OFFICE (E & B6)	LOCATION	ALL STAIRCASES ✓
FRAME TYPE	METAL AS PER APPROVED VENDOR DRAWINGS	FRAME TYPE	METAL AS PER APPROVED VENDOR DRAWINGS
SHUTTER TYPE	SINGLE LEAF FIRE RATED METAL DOOR APPROVED AS PER VENDOR DRAWINGS	SHUTTER TYPE	SINGLE LEAF FIRE RATED METAL DOOR APPROVED AS PER VENDOR DRAWINGS

RAL SHADE?? golo??.

9/6/19 (4)


Its a double leaf door.

DD1A DD2A

SINGLE LEAF FIRE RATED DOOR

THIS DOOR NOMENCLATURE IS SAME FOR FHC DOOR ALSO. CHECK GROUND FLR PLAN.

FHC DOOR WILL HAVE GLASS PANEL

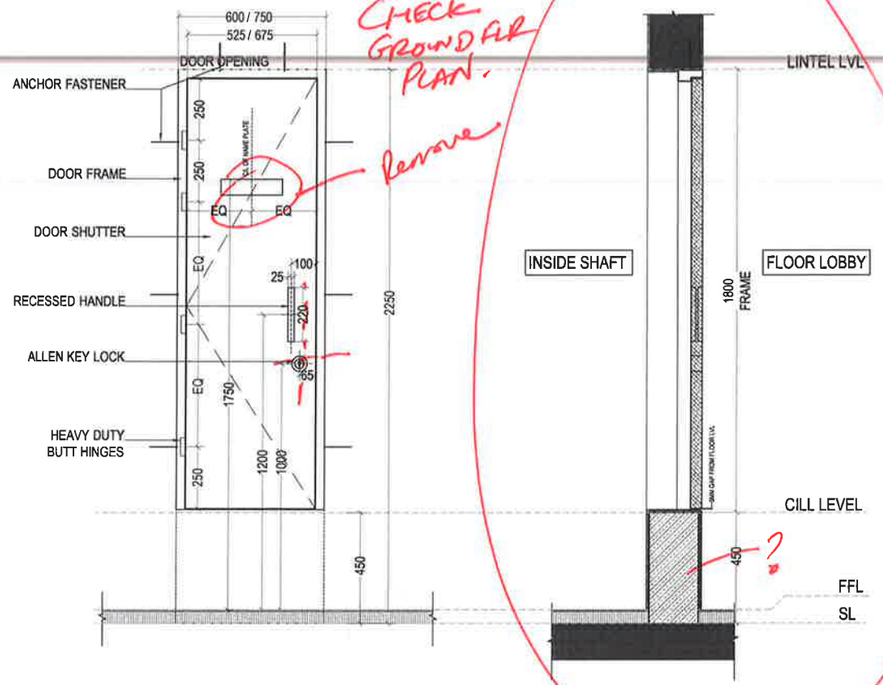

ELEVATION


SECTION

PLEASE USE CORRECT SECTIONS. Typical

CHECK DOOR OPENINGS IN E TYPOLOGY & B6 Separately.

IS THIS FOR GROUND OR FOR TYPICAL FLOOR ??

Give Conditions for B6 4E, 12 B6 Both

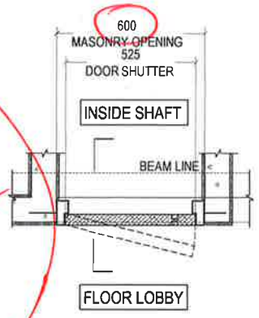


PLAN

D7A D10A

SINGLE LEAF FIRE RATED DOOR


Why a fire Rated Door Required for a GUARDIAN STORE ???

CHECK IF D10A is required as per MEP.

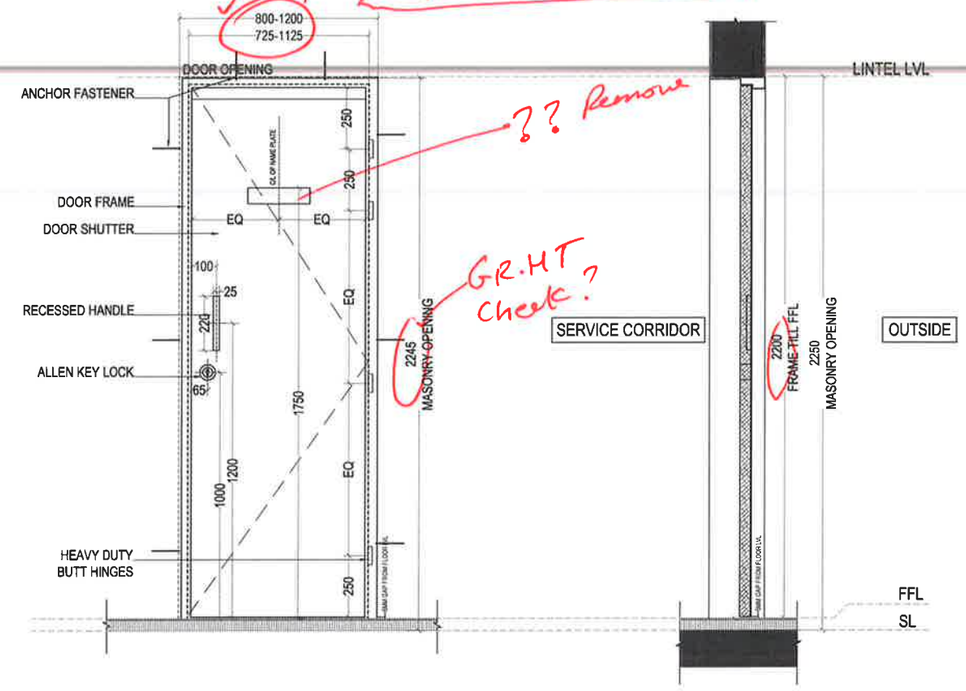

ELEVATION

SECTION

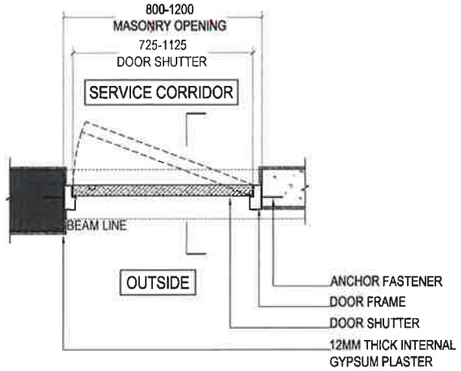


PLAN


TYPE	DD1A	DD2A	TYPE	D7A, D10A (SINGLE LEAF FIRE RATED DOOR)
STRUCTURAL SIZE OPENING	600-750 X 2250	FLOOR ??	STRUCTURAL SIZE OPENING	800-1200 X 2250
LOCATION	OLIVIA - ELEC - SINGLE LEAF FIRE RATED DOOR WM SHAFT - SINGLE LEAF METAL DOOR	OLIVIA - ELV - SINGLE LEAF FIRE RATED DOOR FHC SHAFT - SINGLE LEAF METAL DOOR	LOCATION	FTTH ROOM
FRAME TYPE	METAL AS PER APPROVED VENDOR DRAWINGS		FRAME TYPE	METAL AS PER APPROVED VENDOR DRAWINGS
SHUTTER TYPE	SINGLE LEAF METAL / FIRE RATED METAL DOOR APPROVED AS PER VENDOR DRAWINGS		SHUTTER TYPE	SINGLE LEAF FIRE RATED METAL DOOR APPROVED AS PER VENDOR DRAWINGS

INCLUDING LAMINATE ON BOTH SIDES.


(5)

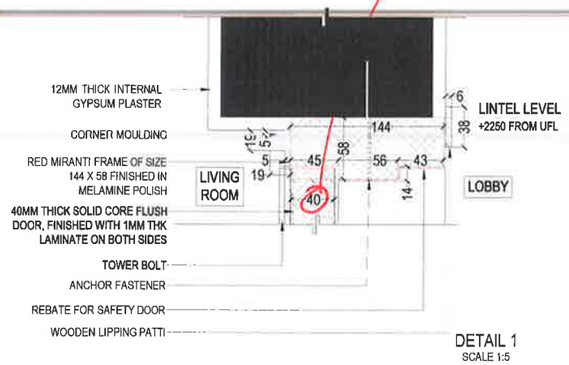


DETAIL 1
SCALE 1:5

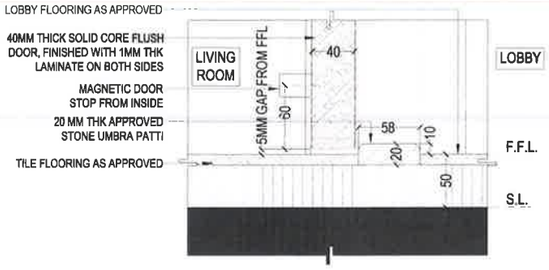


DETAIL 2
SCALE 1:5

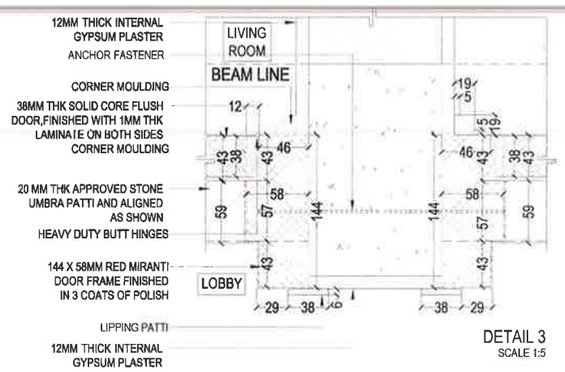


DETAIL 3
SCALE 1:5

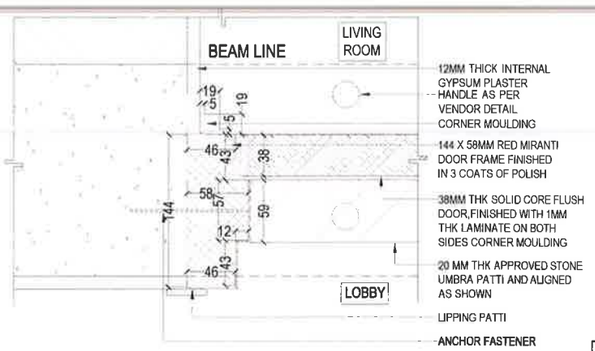


DETAIL 4
SCALE 1:5

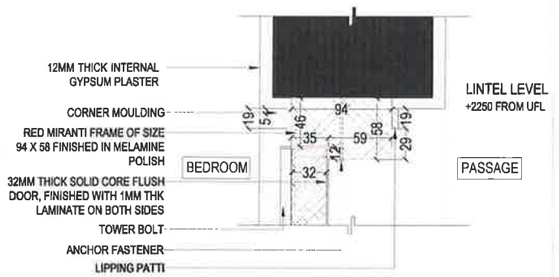


DETAIL 5
SCALE 1:5

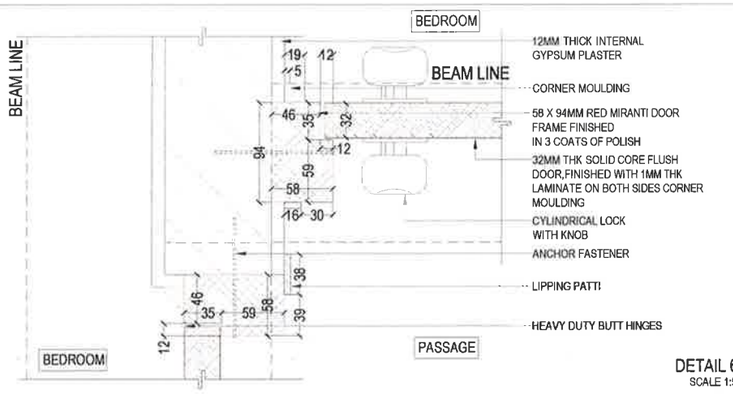


DETAIL 6
SCALE 1:5

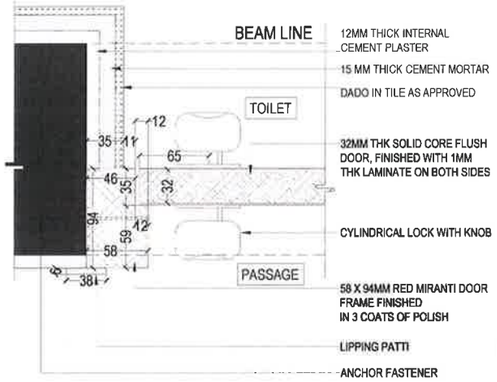


DETAIL 7
SCALE 1:5

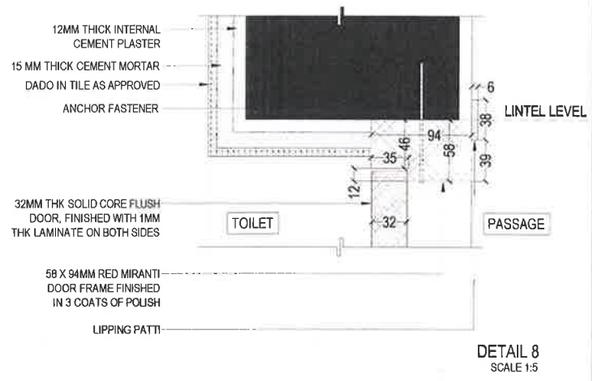


DETAIL 8
SCALE 1:5

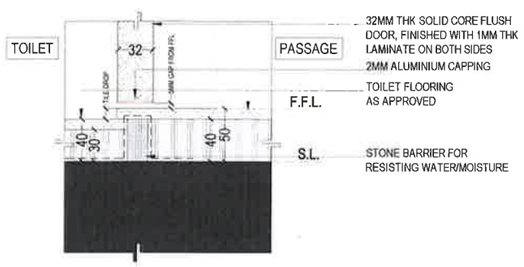

DETAIL 9
SCALE 1:5

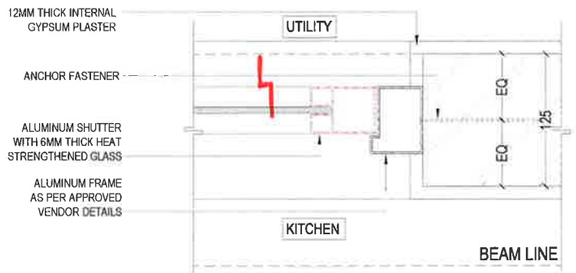

DETAIL 10
SCALE 1:5

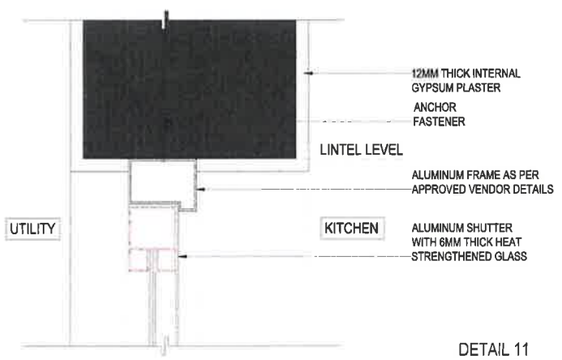

DETAIL 11
SCALE 1:5



DETAIL 12
SCALE 1:5