
20/5/19

FLOREA A & D

SECOND FLOOR PLAN.

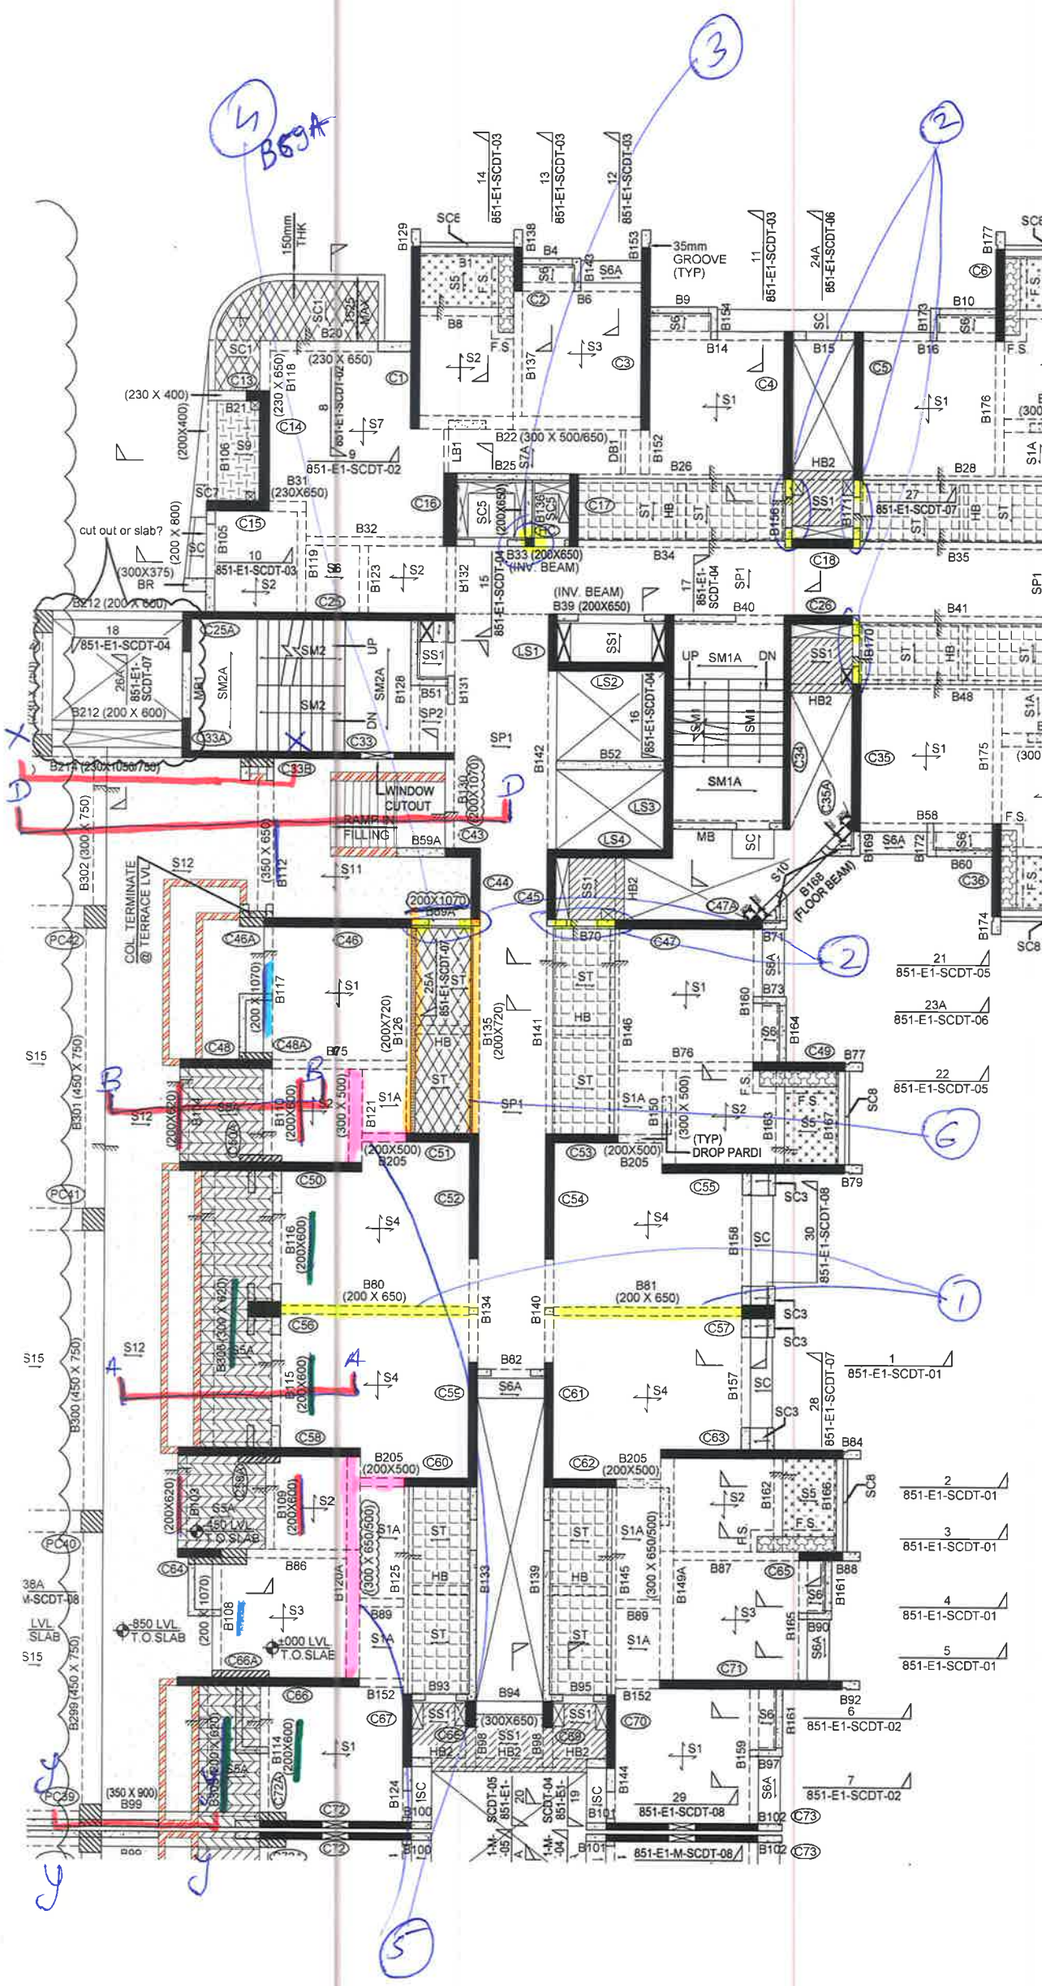

NOTE:- 1) ALL BEAM SIZES ARE (200 X 650) U.N.O.

(1) 230 wide beam as per Shell dwg approval.

(2) Non. Struc. wall extent to be as per Arch. dwg.

(3) Column HC was not a part of Shell dwg. Will it be only on this floor??

(4) Refer section attached for comments.


(5) B120A can be 300X650 only.

(6) Slab thk of 'ST' to be known for B126 & 135 depth to be finalized.

20/5/19
FLOREA A & D
SECOND FLOOR PLAN

on
vels
ork.

1

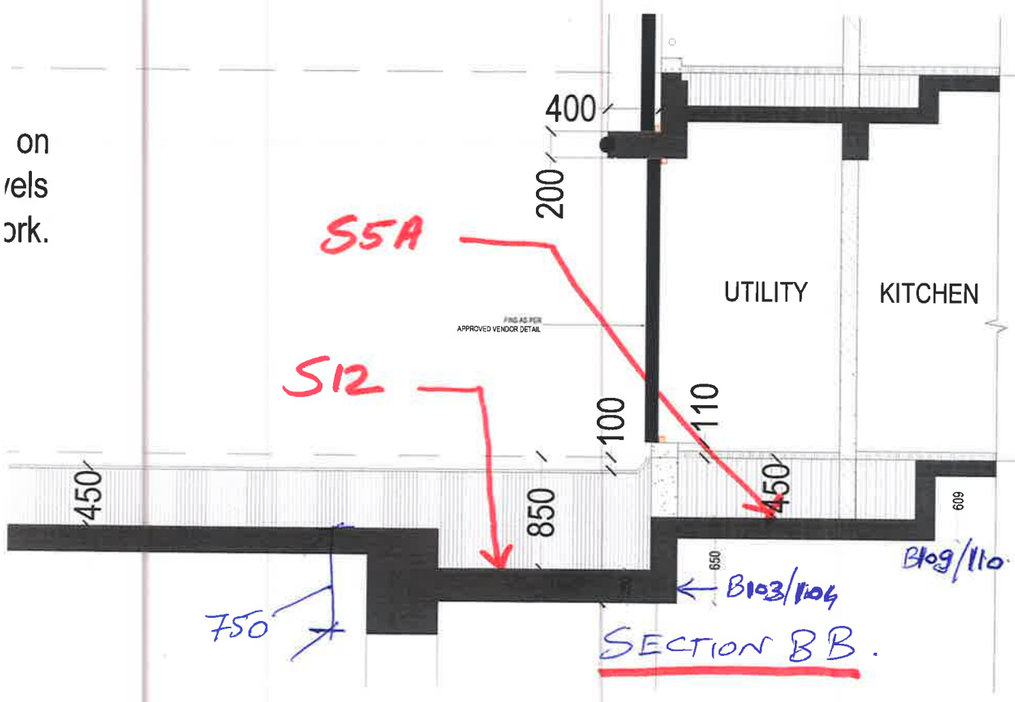


B109/110
B103/104
SECTION BB.

① If S12 is 250 thk then B103 & 104 can be 650 deep.
② If S5A is 200 thk then B109 & 110 can be 650 deep.

2


① If S11 is 250 thk then B130 will be 1100 deep.
② KAPL to check Beam B112.
③ Check Master/Regular Bed Beams B108 & 117 also.

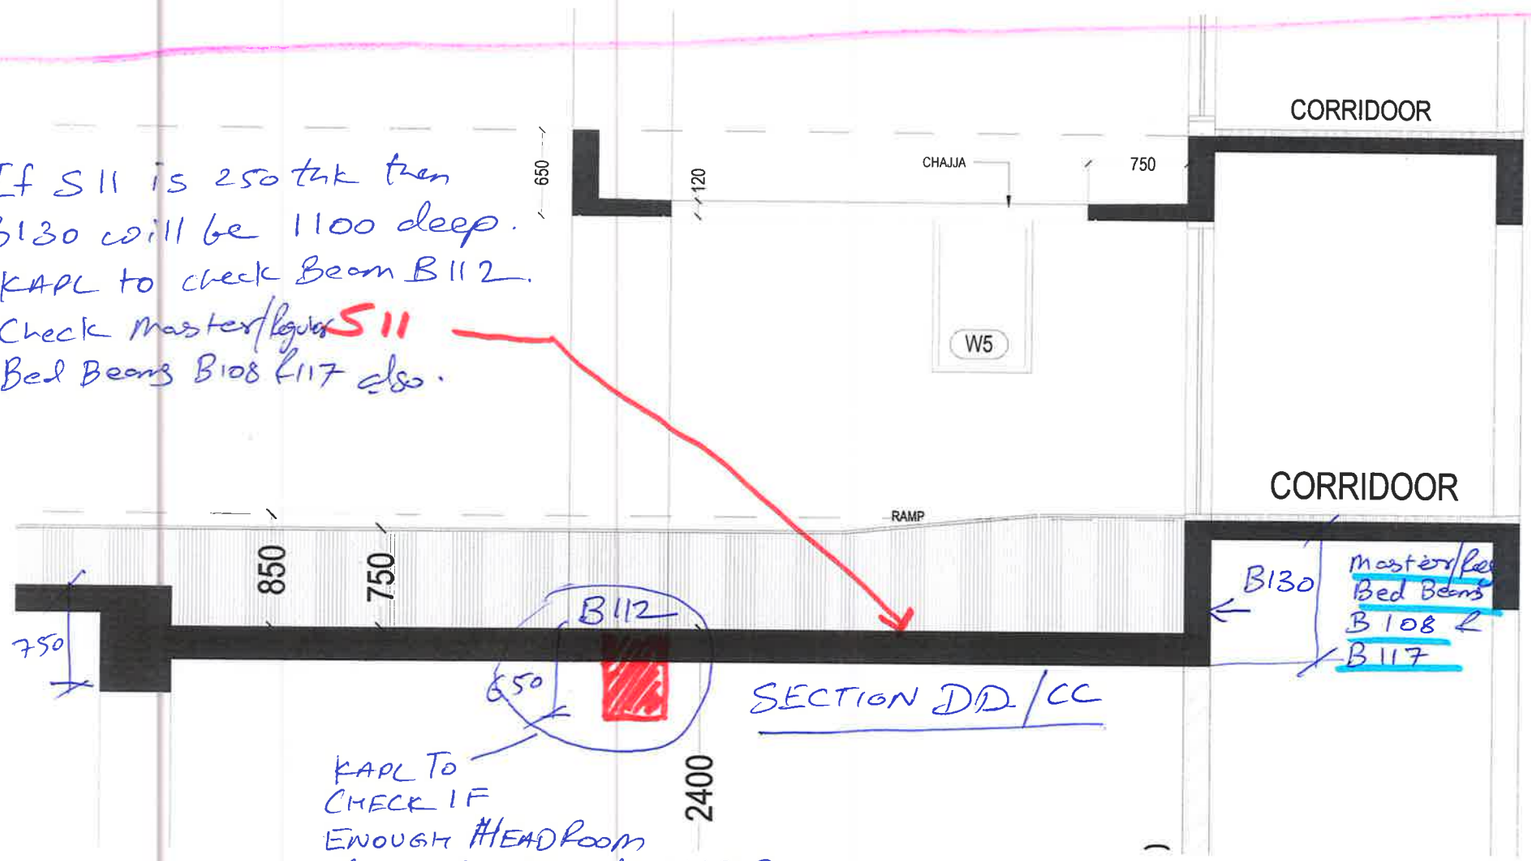

KAPL TO CHECK IF ENOUGH HEADROOM ABOVE LOFT IS AVAILABLE

SECTION DD/CC


3

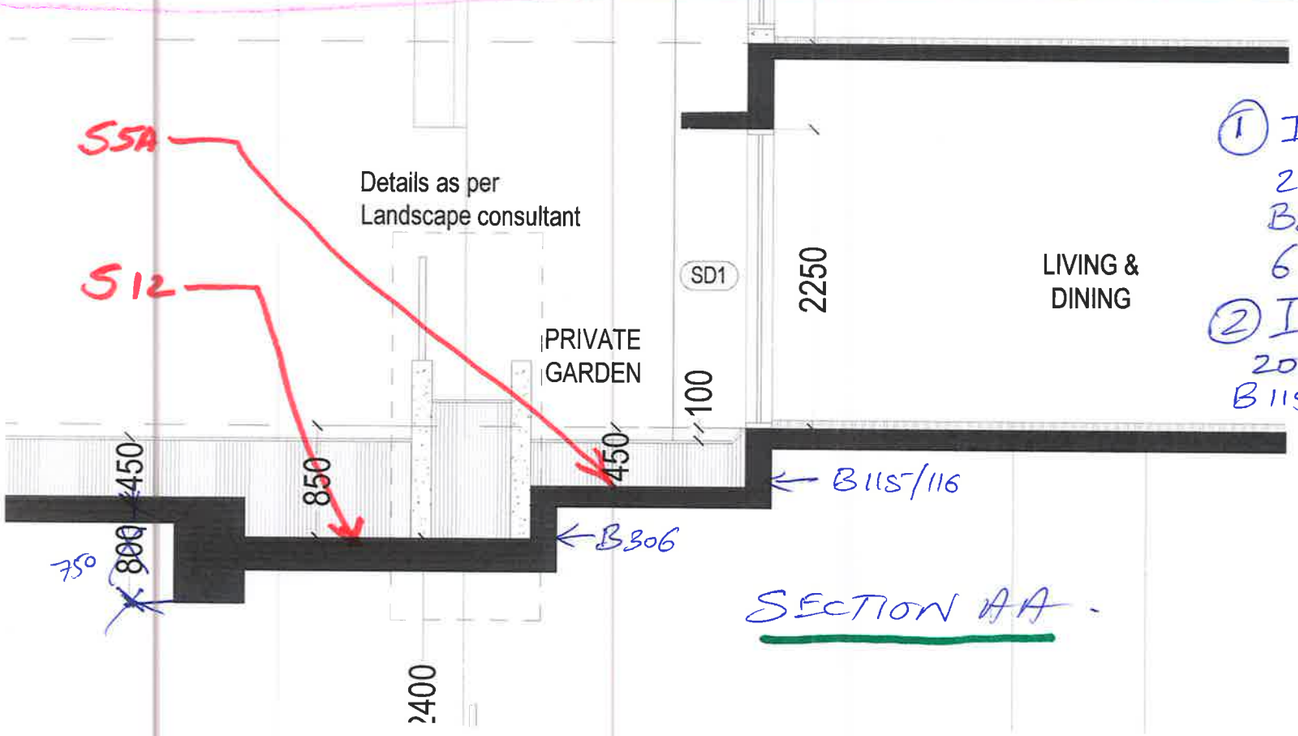

B115/116
B306

SECTION AA.


① If S12 is 250 then B306 can be 650 deep.
② If S5A is 200 thk then B115 & 116 can be 650 deep.

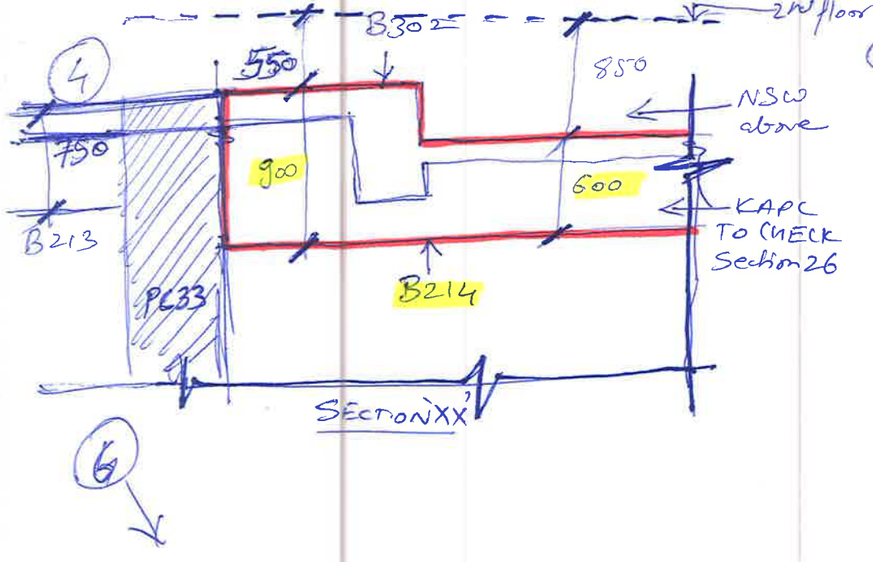

20/5/19

FLOREA A4D

SECOND FLOOR PLAN

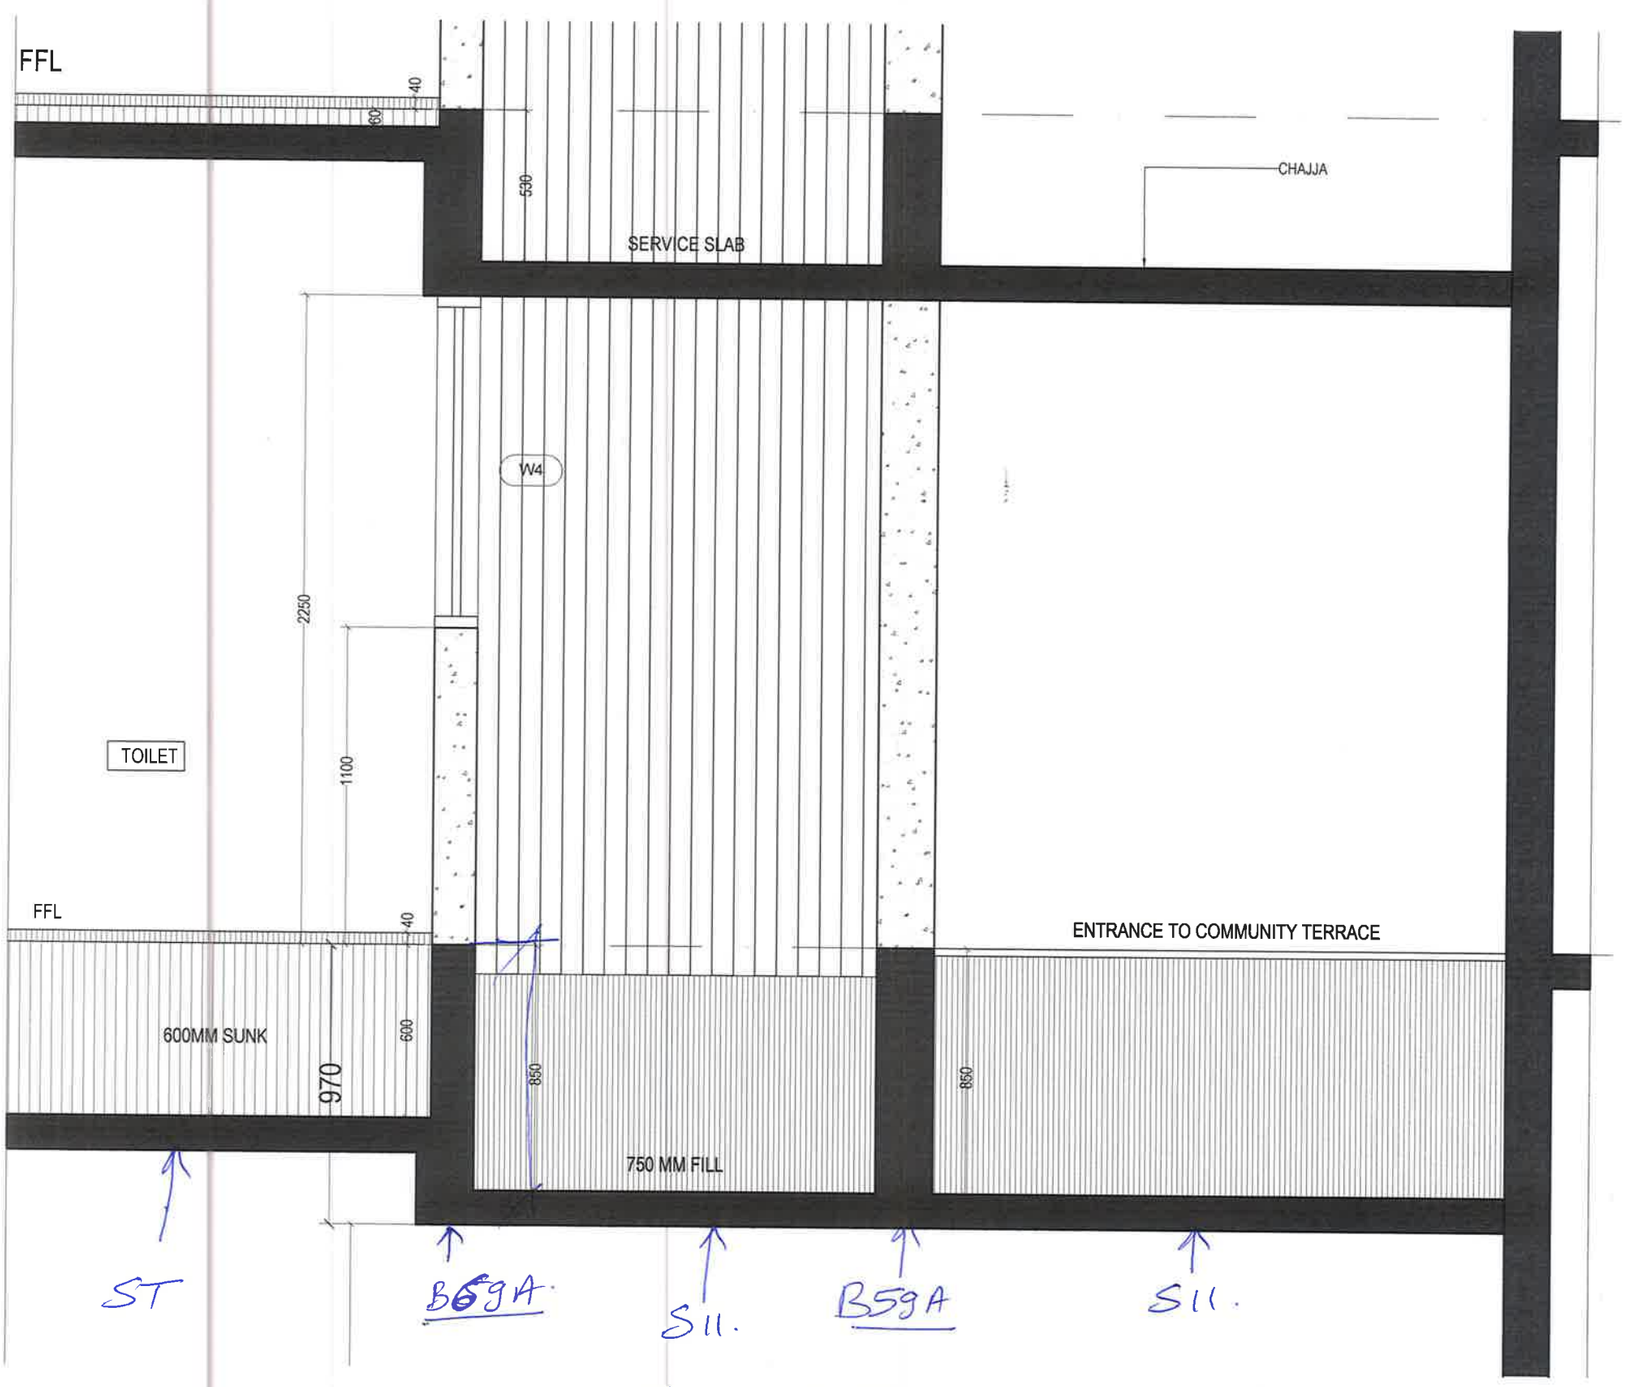

SECTION 25

(1) If S11 is 250 then B69A & 59A will be 1100 mm.

(2) Slab 'ST' thk required.